

0073-1-6640



**Busch-Jaeger
Elektro GmbH**


www.busch-jaeger.de

0073-1-6640
Rev. 1

Raumpanel	6136/30M-101
	6936/30M-101
Controlpanel	6136/100M-101
	6936/100M-101
Controlpanel	6136/100C-101
	6936/100C-101
Controlpanel	6136/100CB-101
	6936/100CB-101

24.01.2006

ENG Operating Instructions

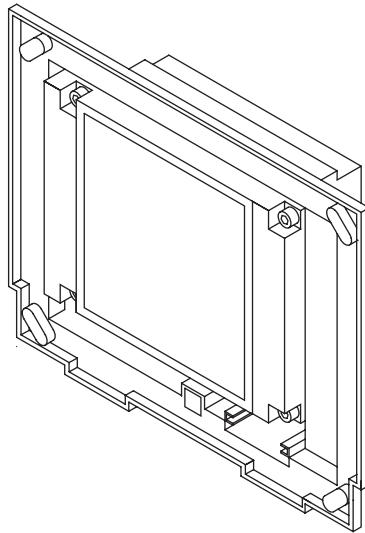

1 Contents

1	Contents	3
2	Safety	5
3	Technical data	6
4	Unit view	7
5	Function overview	8
6	Operation	9
6.1	Touch screen	9
6.2	Fundamentals	9
6.3	Safeguarding the screen	11
6.4	System settings	12
6.5	Room thermostat, climate	17
6.5.1	Integrated room thermostat	18
6.5.2	External room thermostats	19
6.6	Time programmes	20
6.6.1	Calling up/modifying time programmes	21
6.6.2	Modifying switching times	22
6.6.3	Astro function	23
6.6.4	Setting of PIN code	25
6.7	Holiday and presence simulation	26
6.8	Lights and light scenes	28
6.8.1	Controlling light	28
6.8.2	Calling up/modifying light scenes	28
6.9	Controlling blinds/roller blinds	30
6.10	List of alerts	31
6.11	Information	34
6.12	Timer/Alarm clock	35

7	Remote control	36
7.1	Busch-Jaeger hand-held transmitter 6010-25.....	36
7.2	Bang & Olufsen hand-held transmitter BEO4.....	37
7.2.1	Switching and dimming of lamps	38
7.2.2	Calling up and saving light scenes	39
7.2.3	Switching off the consumers.....	39
8	Installation.....	40
8.1	Electric installation	40
8.2	Installation of room/control panel	41
9	Software	42
9.1	Installation	42
9.2	Programming.....	43

2 Safety



Work on the 230 V supply system may only be performed by specialist staff! De-energize mains power supply prior to installation and/or disassembly!



A scratched screen surface will affect monitor handling.

Never use any hard or sharp-pointed objects for entries on the touch screen monitor. The screen surface may be damaged by such objects!



Do not spray any detergents directly on the screen surface.

Clean the screen using a soft cloth and commercially available glass cleaner.

3 Technical data

Rated voltage	230V $\pm 10\%$, ~50 Hz/60 Hz
Power consumption	< 20VA
Operating temperature	0°C to +45°C
Storage	-20°C to +60°C
Bus connection (TP)	Bus terminal block
Room thermostat measuring range	0°C to +40°C
Dimensions incl. frame (W x H x D)	218 mm x 185 mm x 67 mm
Flush-mounting box	
Dimensions (W x H x D)	200 mm x 164 mm x 60 mm

4 Unit view

- 1 Display 320 x 240 pixels
- 2 MMC/SD card reader

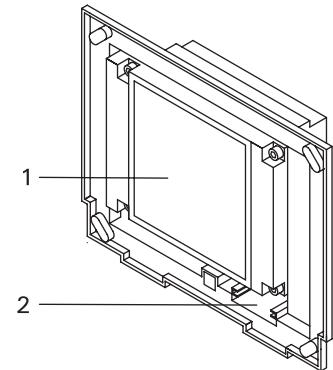


Fig.1

5 Function overview

Function	6136/30M-101	6136/100M-101	6136/100C-101
	6936/30M-101	6936/100M-101	6936/100C-101
			6136/100CB-101
			6936/100CB-101
Total of functions	80	210	210
Scope of scenes	32 scenes, 10 actuator groups	32 scenes, 20 actuator groups	32 scenes, 20 actuator groups
Scope of time programmes	5 channels with 5 switching times each	20 channels with 10 switching times each	20 channels with 10 switching times each
Number of alarm/fault messages	10	10	10
IR channels	16	16	16
Presence simulation	yes	yes	yes
Integrated room thermostat	yes	yes	yes
Display 320 x 240 pixels	Grey levels	Grey levels	256 colours
Message function	no	yes	yes
Info function	no	yes	yes
Alarm clock/timer function	no	yes	yes
Card reader	SD, MMC	SD, MMC	SD, MMC

6 Operation

6.1 Touch screen

The screen has a surface which reacts when touched (touch screen). To navigate in the control system, touch the buttons on the operating surface. Use the supplied pen or a finger to do this.

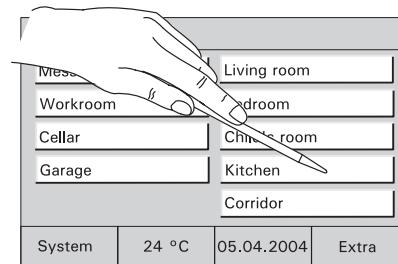


Fig.2

6.2 Fundamentals

The functions of the room/control panel are software-dependent and are determined by the saved project.

Thus the appearance of the operating pages varies as well.

- Every page can be programmed individually. 5 or 10 touch buttons or up to 8 icons can be displayed.

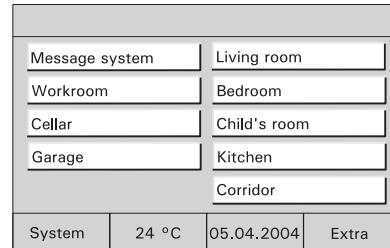


Fig.3

The buttons "1" (Fig. 4) and "2" (Fig. 5) or any other buttons allow changing between the different screen views.

Blind	
Living room blind	Up
Bedroom blind	Up
Child's room blind	Up
Kitchen blind	Up
Wind alarm	No
Home	24 °C
24 °C	05.04.2004
05.04.2004	Next



Fig. 4

Blind	
Terrace roller blind	Up
Winter garden sun-blind	Up
Wind alarm	No
Home	24 °C
24 °C	05.04.2004
05.04.2004	Back



Fig. 5

On the room panels 6136/xx and 6936/xx, up to 8 operating pages can be programmed and up to 21 operating pages in the control panels 6136/xx and 6936/xx.

All pages can be individually adapted to the project. A reasonable page structure may e.g. be room-oriented (Fig. 6) or function-oriented (Fig. 7). It is possible to initiate switching processes directly through touch buttons (depending on the programming) or to call up a pop-up window to initiate switching processes (Fig. 11).

Message system	Living room
Workroom	Bedroom
Cellar	Child's room
Garage	Kitchen
Corridor	
System	24 °C
24 °C	05.04.2004
05.04.2004	Extra

Fig. 6

Message system	Heating system
Blind	Alarm system
Outdoor lighting	Central functions
Indoor lighting	
System	24 °C
24 °C	05.04.2004
05.04.2004	Extra

Fig. 7

Media pages

Audio and video equipment may be controlled directly through icons if this has been implemented during the configuration of the room/control panel (Extra devices to execute the EIB-Telegramms are necessary).

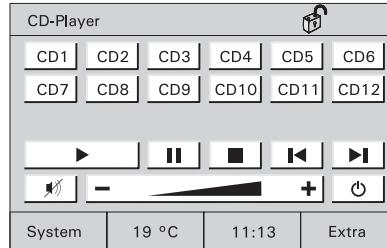


Fig. 8

6.3 Safeguarding the screen

To safeguard the unit against unauthorized or unintended use, call up the main page and press on the start page title on the top left in the display for more than 3 seconds.

At the top right of the display, the "Lock" symbol appears being closed. The display is now safeguarded and cannot be operated any more.

 The display is only enabled by pressing long again.

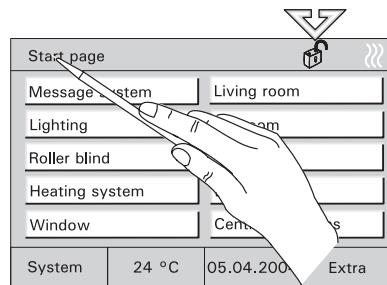


Fig. 9

 Safeguarding the display is recommended whenever the unit is installed in areas where many people come and go or as a child lock.

6.4 System settings

Select the "System" button on the main page to access the basic unit settings and to adapt them if required or to transfer a new project.



Access to the system settings can be safeguarded by a PIN code or completely blocked.

When the system settings are blocked, they cannot be accessed or modified by the user. In this case, please contact your electrician.

- Enter your PIN code if available.

Date

- Set the correct date using the arrow keys.
- Confirm your entry with "OK".

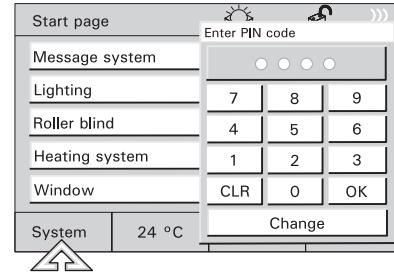


Fig.10

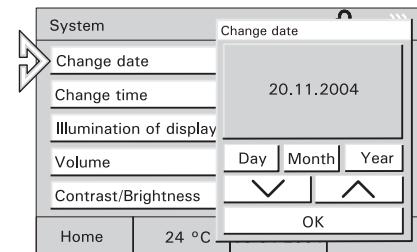


Fig. 11

Time

- Set the correct time using the arrow keys.
- Confirm your entry with "OK".

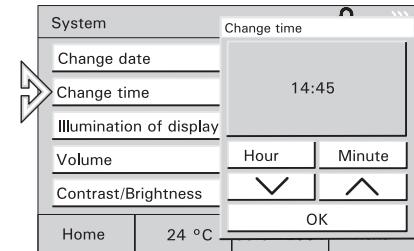


Fig. 12

Display lighting

To save energy, the display lighting switches itself off automatically when the unit is not actuated.

- Select the desired "Lighting Off" time from the list or disable the automatic "Lighting Off" function.
- Confirm your entry with "OK".

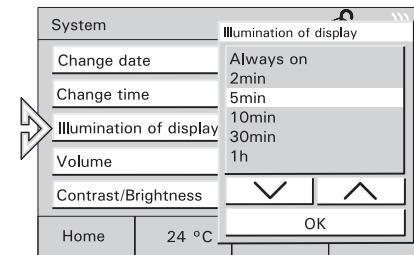


Fig. 13

Volume**Caution!**

These settings also apply to the alarm sounds.

- Set the volume of sound messages using the slider or the arrow keys.
- Confirm your entry with "OK".

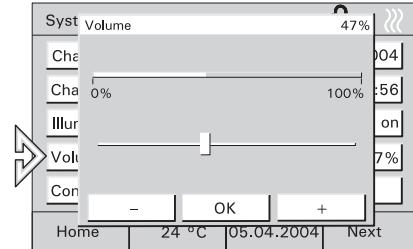


Fig. 14

**Contrast/
Brightness**

- Set the screen brightness and the contrast using the sliders.
- Confirm your entry with "OK".

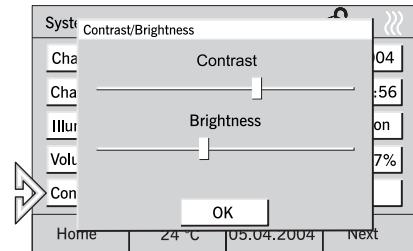


Fig. 15

**Warning
tones**

The warning tones are subdivided into further sub-categories:

- Alert messages
- Timer/Alarm clock
- Incorrect input
- Keypad tones

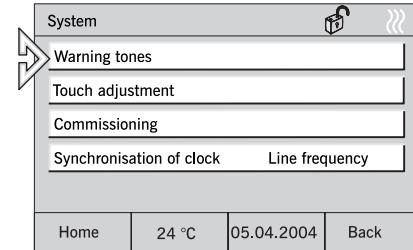


Fig. 16

Alert message

- You may select the alert message tone from the list.
- You may also test the selected tone if you wish.
- Confirm your entry with "OK".

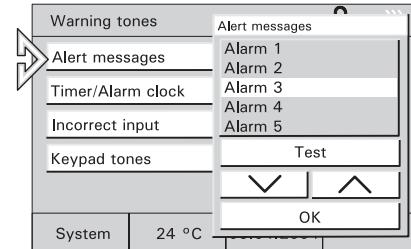


Fig. 17

**Timer/
Alarm
clock**

- You may select the timer/alarm clock tone from the list.
- You may also test the selected tone if you wish.
- Confirm your entry with "OK".

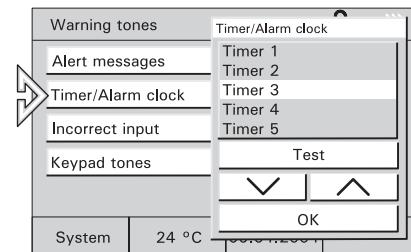


Fig. 18

**Incorrect
input**

- You may enable or disable the signalling tone for incorrect inputs.
- Confirm your entry with "OK".

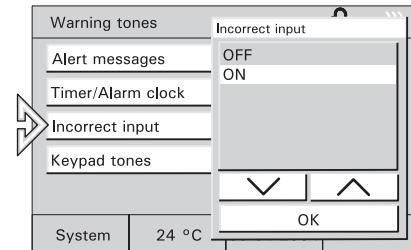


Fig. 19

Keypad tones

- You may enable or disable the signalling tone for button actuation.
- Confirm your entry with "OK".

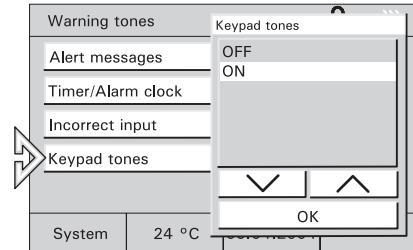


Fig. 20

Touch adjustment

Adjusting the touch display will usually not be necessary. Should you still go wrong frequently with your pen or your finger, please adjust the touch display.

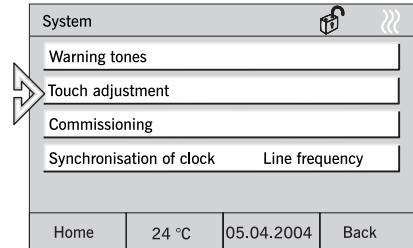


Fig. 21

- To do this, point your pen exactly into the appearing target points.

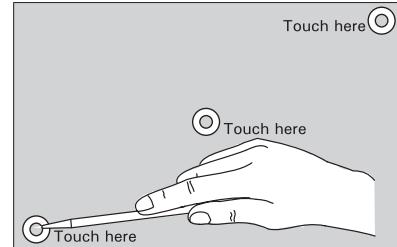


Fig. 22

**Commiss-
sioning** Call up commissioning only if the unit is to be re-programmed.

- See chapter "Programming".

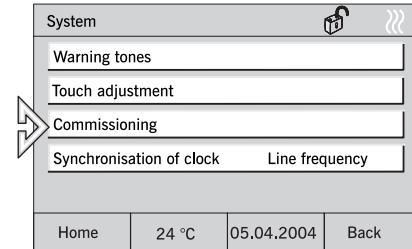


Fig. 23

**Synchro-
nisation of
Clock** You can ensure (synchronise) the accuracy of the device-integrated clock either through the power supply network or through a quartz crystal.

A synchronisation through the internal quartz crystal is necessary when the room/control panels is used in conjunction with instable power supply networks (e.g. generator mode).

- Confirm your entry with "OK".

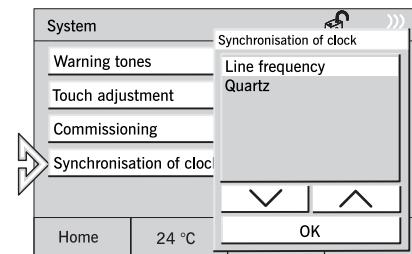


Fig. 24

6.5 Room thermostat, climate

The integrated room thermostat ensures the set climate and the desired temperature inside the room. The user may modify the set room temperature and the thermostat operating mode at any time. E.g. a nighttime temperature reduction can be activated, i.e. the room temperature is reduced automatically at night.

This unit can also control room thermostats in other rooms and/or in the entire building, e.g. for realizing a central nighttime temperature reduction feature. Please refer to the chapter "External room thermostats".

6.5.1 Integrated room thermostat

- Select the room temperature display button on the main page in order to call up or adapt the settings of the integrated room thermostat if necessary.

 The current operating mode of the room thermostat (heating/cooling) is shown as a symbol on the main page.

Room thermostat operating modes

- Stand-by: The comfort temperature is slightly reduced.
- Comfort: The set room temperature is permanently maintained.
- Nighttime temperature reduction: Reduction of room temperature.

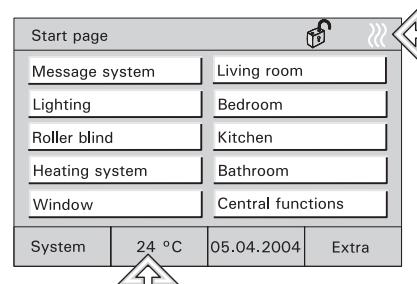


Fig. 25

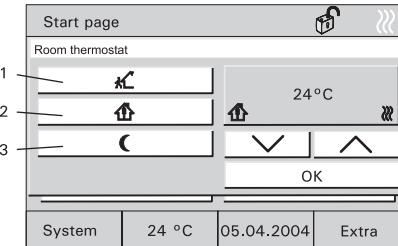


Fig. 26

Setting the room thermostat

- Select the desired operating mode.
- Set the desired set value using the arrow keys.
- Confirm your entry with "OK".

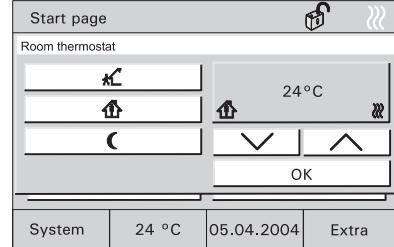


Fig. 27

6.5.2 External room thermostats

- Select the "Heating system" button on an operating page (or another button as required).
- The operating page with the available room thermostats is opened

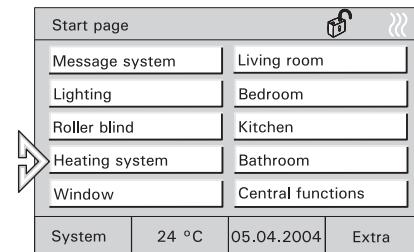


Fig. 28

Room thermostat operating modes

- 1 Stand-by: The room temperature is slightly reduced.
- 2 Comfort: The set room temperature is permanently maintained.
- 3 Nighttime temperature reduction: Reduction of room temperature.

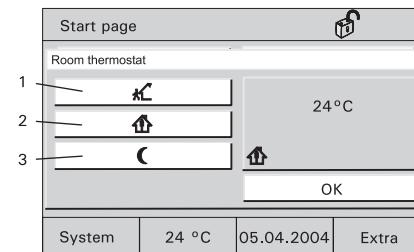


Fig. 29

Displaying and/or modifying the room thermostat

- Select the desired room thermostat.
- The current operating mode is displayed and can be changed if necessary.
- Select the operating mode to be changed.
- Confirm your entry with "OK".

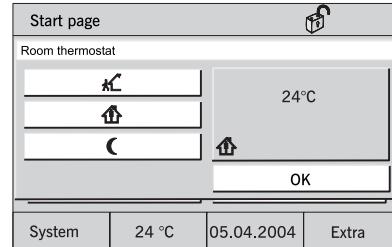


Fig. 30

6.6 Time programmes

All switching functions for lighting, blinds or the heating system can also be controlled automatically using time programmes. A consumer, e.g. a lamp can be switched ON or OFF on certain days, every day or during the weekend only if desired.

A maximum of 20 electrical units of the EIB/PN system can be controlled at 5 (room panel) or 10 (control panel) different times each. This allows up to 200 time functions.



Access to the time programmes can be completely blocked or safeguarded by a PIN code. Now the time programmes cannot be opened or modified by the user. In this case contact your electrician (see also chapter "Setting of PIN code").

6.6.1 Calling up/modifying time programmes

- To call up and modify the time programmes, select the button displaying the date/time.
 - The possible time programmes are displayed.

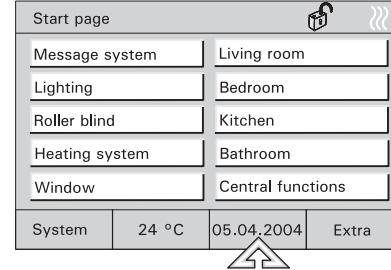


Fig. 31

- Select the desired time programme.
 - The possible switching times are displayed.

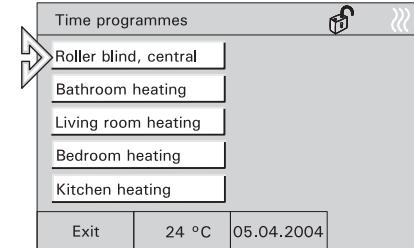


Fig. 32

- Select a switching time.
 - The programmed parameters are displayed.

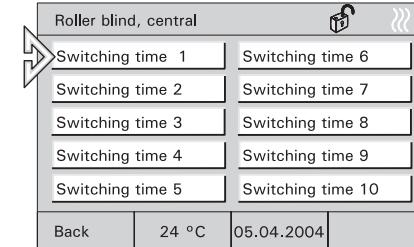


Fig. 33

6.6.2 Modifying switching times

- Setting the weekday

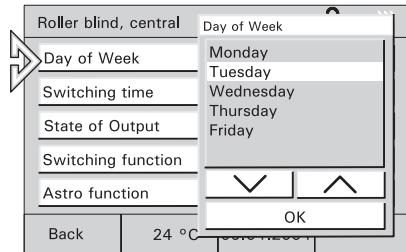


Fig.
34

- Setting the switching time

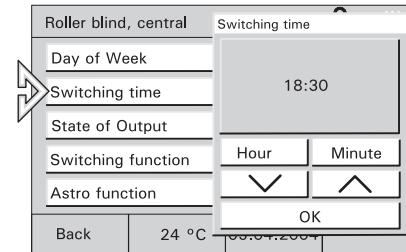


Fig. 35

- Setting the switching status

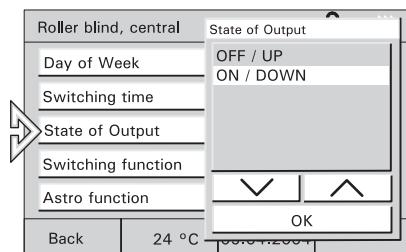


Fig.
36

- Setting the switching function
(see chapter 6/7)

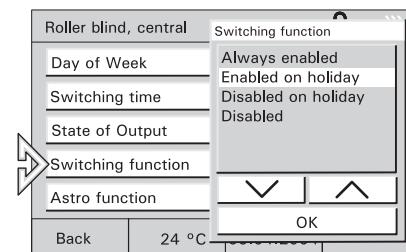


Fig. 37

6.6.3 Astro function

The astro function automatically adapts the switching times to the course of the year (e.g. the blinds open earlier during summer than during winter).

- To activate the astro function, select the "Astro Function" button.
 - The Astro Function is displayed.
- Enable the astro function.

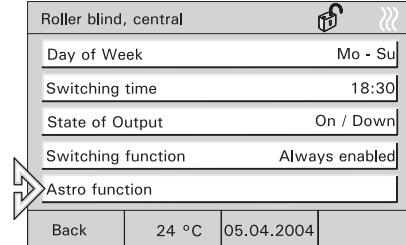


Fig. 38

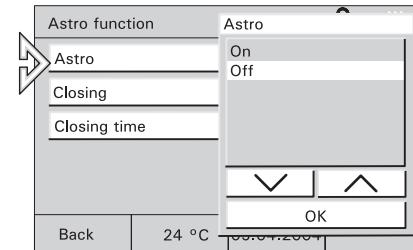


Fig. 39

Enabling "Restriction of Astro settings":

- In the first step, select the "Closing" button and enable your selection.

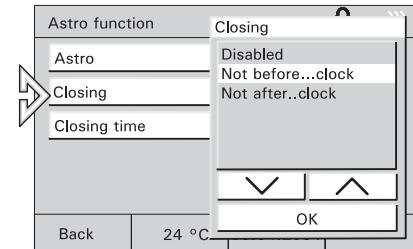


Fig. 40

- In the second step, select the "Closing Time" button and enter the desired time.

 To enter further times, go back to the switching times and select the next switching time there.

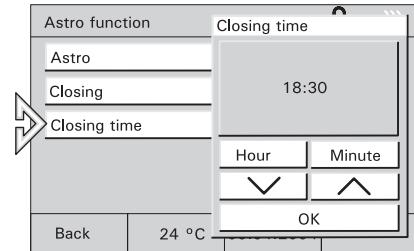


Fig. 41

6.6.4 Setting of PIN code

Certain settings of the room/control panels can be safeguarded by a PIN (personal identification number). If required, enter your PIN on the keypad. A different 4-digit number may be used for each function area.

PIN code-protected areas may be:

- Modification of system settings
- Modification of time programmes
- Activation of message system

1. To modify the PIN, e.g. select the "Message system" page and open the "Change PIN-Code" menu.
2. Now press the "Change" button. Now you will be requested to enter the current PIN.
3. Enter the current PIN code.
4. Confirm your entry with "OK" and enter the new PIN code.
5. Confirm your entry with "OK".
6. Enter the new PIN code one more time.
7. Confirm your entry with "OK".

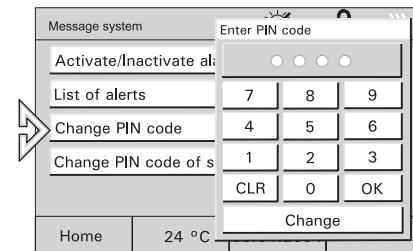


Fig. 42

6.7 Holiday and presence simulation

Holiday function If certain time programmes are to be carried out only during your holidays (e.g. temperature reduction) or not during your holidays (e.g. automatic outdoor lights), the holiday function allows setting this in the time programmes, see chapter 6.6.2.

- First proceed as described in chapter 6.6.1.
- Enable the switching function as desired.

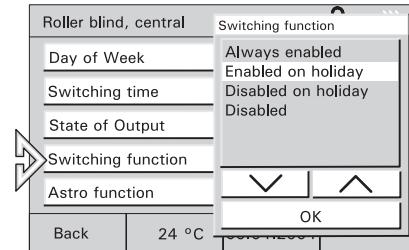


Fig. 43



For displaying time programmes see chapter: "Calling up/modifying time programmes".

- To enable the holiday function, select the "Extra" page and go to the second page.
- Enter the date of your holiday using the arrow keys.

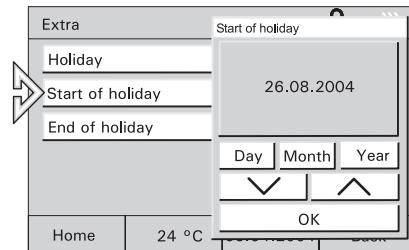


Fig. 44

- Enable the holiday function.

The time programmes which are only or not carried out during holidays are enabled or disabled at the set dates.

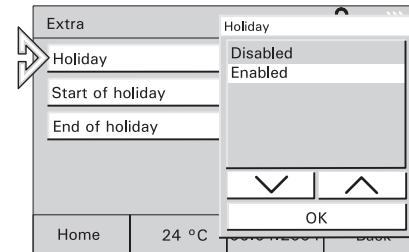


Fig. 45

Presence simulation

To make your house appear as if there are people living in it although you are absent, enable the integrated presence simulation function. This function allows switching up to 10 units on and off during the day or opening and closing the blinds.

The presence simulation records the switching statuses of up to 10 units per day and stores them, e.g. switching-on of ceiling lighting in the living room at 8:00 p.m. on Monday. All switching statuses of one week are stored.

- To enable the presence simulation, select the corresponding operating page.
- Select "Presence simulation" and enable the function in the pop-up window.

The switching operations carried out during the previous week are now automatically repeated.

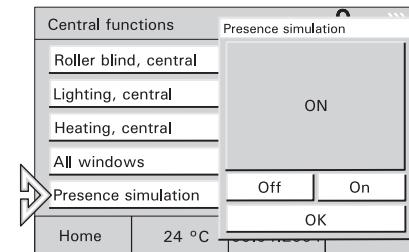


Fig. 46

6.8 Lights and light scenes

The individual and flexible configuration of the touch buttons allows switching all electrical units which are integrated into the EIB or Powernet system, especially lamps. The respective switching statuses are shown in the display either as plain text or as symbols (e.g. an incandescent lamp).

6.8.1 Controlling light

- For light control, select e.g. one room button on the start page and then the lighting button.
- Here you can switch the light on and off.

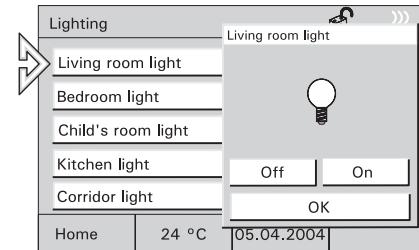


Fig. 47

6.8.2 Calling up/modifying light scenes

Individual light atmospheres can be called up using light scenes, i.e. different lights are automatically set to different brightness values in a given room. At the same time, e.g. the blind or a linen is rolled down. In this way, individual lighting scenes for the most varied situations, e.g. reading, watching TV or for presentations and demonstrations can easily be realized.

All settings within a scene can be adapted and then saved.

Up to 32 light scenes can be realized within a project, with a total of 10 (room panel) or 20 (control panel) EIB units being controllable.

Calling up light scenes

- To start a light scene, select a button for an area, e.g. "Living room" on the start page and then the button for a light scene.
- Start the light scene here using the corresponding button.

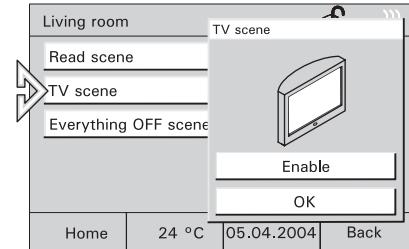


Fig. 48

Modifying and saving light scenes

- Start the desired light scene.
- Now set the electric consumers so that the lighting complies with your wishes.
- Save the setting by touching the corresponding button long (approx. 4 s.).
- The button reads "Saving" as a feedback.

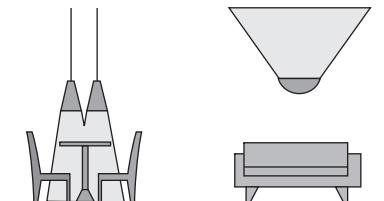


Fig. 49

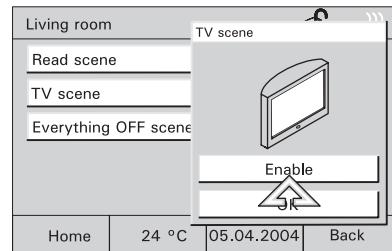


Fig. 50

6.9 Controlling blinds/roller blinds

All blinds and roller blinds integrated into your EIB/Powernet system can be controlled if this has been configured in your project.

Manual control

- To control the roller blind, select e.g. the button "Roller blind" on the start page and then the corresponding button.
- Use the arrow keys to move the blinds/roller blinds up or down.
- Press briefly to stop and adjust slats.
- Press long to move up or down.

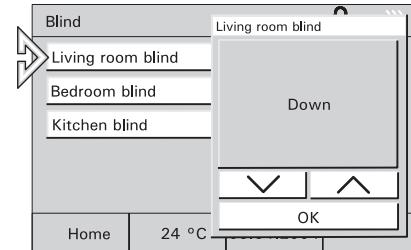


Fig. 51

Control by time programmes

For information about roller blind control by time programme, see chapter: "Calling up/modifying time programmes".

6.10 List of alerts

To notify faults in the EIB system or triggered alerts, the room/control panel can generate and manage messages and show them on the display, e.g. heating system failure or alarm system activation.

List of alerts

If there is an alert, a special window opens where the message is displayed in plain text with date and time.

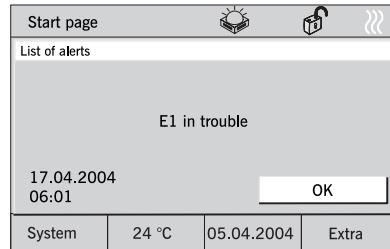


Fig. 52

The displayed messages remain in the foreground until they are acknowledged by a user. This also applies if the reason for the alarm or the fault has meanwhile been removed and the normal condition has been restored.

This guarantees that an alarm or a fault will not go unnoticed.

An acoustic signal can indicate that there is a fault/alarm (see chapter: System settings).

Acknowledged messages appear in a list, you can call up by using the button "Extra" (Fig 53).

The "Clear list" button deletes all entries.

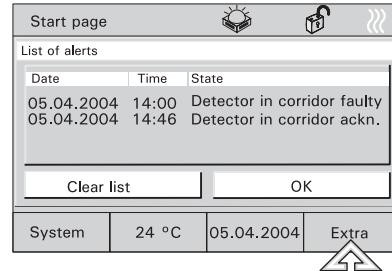


Fig. 53

**Message function
(only for control panel)**

The control panel can be used as a message centre, i.e. windows and doors can be monitored using window contacts and rooms can be monitored by means of motion detectors.

If a window is broken open or if a motion detector detects a motion inside a room while the message system is activated, a message is transmitted to the control panel which now triggers the internal alarm. In addition, e.g. an external horn or a siren can be switched on.

At the same time, the message is displayed in the display (see also "List of alerts"). If required, a message may also be transferred to a telephone interface which informs you or calls for further help by phone.

If a window contact of a motion detector is faulty, this is indicated by a corresponding fault message (see "List of alerts").

Activation and inactivation of the system can be directly on the control panel after entering a PIN code or by corresponding bar-type switching contacts, block locks, keylock switches or PIN code keypads, e.g. when leaving the house.

Activation/inactivation of message centre

- To activate/inactivate the message centre, select the "Message system" page and then the button "Activate/Inactivate Alarm System".

 The operating status of the message system is shown by a symbol.

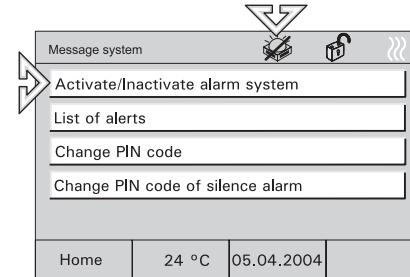


Fig. 54

- After selecting "Armed" or "Disarmed", you will be requested to enter the PIN code.

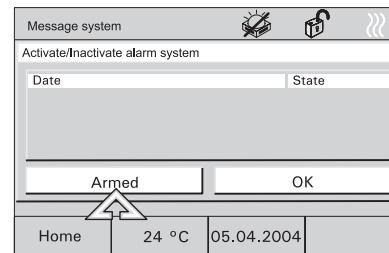


Fig. 55

- After confirming the entry with the "OK" button, the message centre is activated or inactivated.

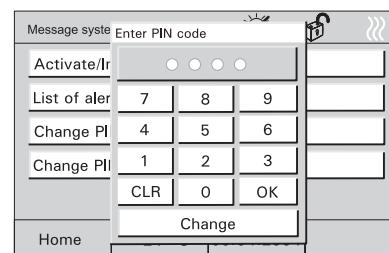


Fig. 56



The PIN code can be changed only when the message centre is inactive.

6.11 Information

You may leave a message for someone by using the info function. When enabling this function, an empty display page or the last saved information is shown.

Each message remains in the foreground until it is confirmed with "OK" or deleted with "Clear".



A symbol indicates when an information has arrived.

- To write an information, select the "Extra" page and then the "Infopage" button.
- The info page is displayed.

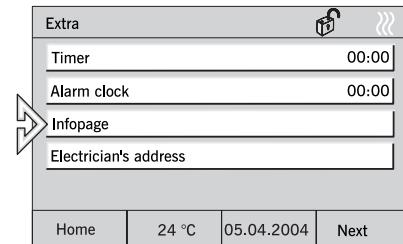


Fig. 57

- Write a note using the PDA pen or edit a saved information.

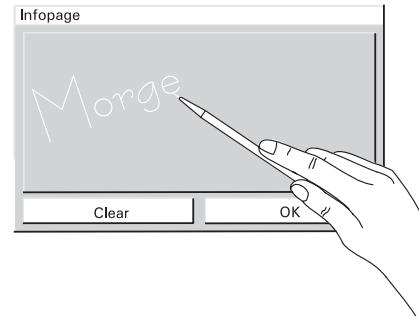


Fig. 58

6.12 Timer/Alarm clock

The "Timer" function allows setting a space of time which is counted backwards after activation (hourglass).

A certain time is set using the "Alarm clock" function.

In both cases, your attention will be drawn to the expiry of the set time by an alarm sound.

- To set the time, select the "Extra" page and then the "Timer" or "Alarm clock" button.
- After setting the time, enable the timer/alarm clock with the "Start/Stop" button.

An enabled timer or alarm clock is shown by a symbol.

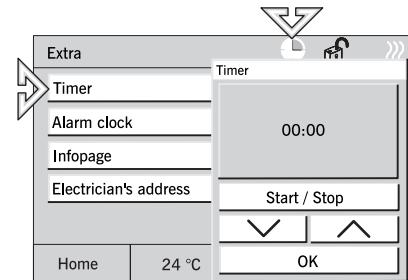


Fig. 59

7 Remote control

7.1 Busch-Jaeger hand-held transmitter 6010-25

All room and control panels are equipped with an infrared receiver and may be remote-controlled with the Busch-Jaeger hand-held transmitters 6010-25 and 6010-25-500.



For detailed information and operating information, please refer to the separate Instruction Manual of the hand-held transmitter.




Fig. 60

7.2 Bang & Olufsen hand-held transmitter BEO4

 The Bang & Olufsen hand-held transmitter BEO4 only works together with the control panels 6136/100CB and 6936/100CB.

The IR hand-held transmitter provides the following possibilities for controlling the room panel:

Light: Modification of lighting

Record: Saving a light scene

0 – 9: Selection of lamp 1 to 10

A: Selection of light scene 1

C: Selection of light scene 2

D: Selection of light scene 3

F: Selection of light scene 4

B: On or brighter

E: Off or darker

Stop: Everything off

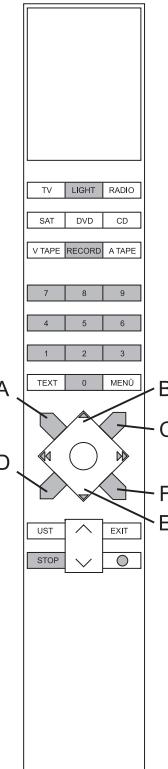


Fig. 61

7.2.1 Switching and dimming of lamps

- Press "Light" button on remote control unit.
 - The word "LIGHT" appears in the remote control unit display. This mode is active for 25 seconds. After this, the display goes back to audio/video. Press the LIGHT key one more time if required.
- Switch the lamps according to the table below.



„LIGHT+1+B“ in the table means that these three keys must be pressed one after the other (not simultaneously).

Function	Keys to be pressed
Lamp 1 ON	LIGHT+1+B
Lamp 1 brighter	LIGHT+1+B (press B permanently)
Lamp 1 OFF	LIGHT+1+E
Lamp 1 darker	LIGHT+1+E (press E permanently)
Lamps 2 – 9 are actuated in the same way as lamp 1.	
Lamp 10 ON	LIGHT+0+B
Lamp 10 brighter	LIGHT+0+B (press B permanently)
Lamp 10 OFF	LIGHT+0+E
Lamp 10 darker	LIGHT+0+E (press E permanently)

7.2.2 Calling up and saving light scenes

- Press "Light" button on remote control unit.
 - The word "LIGHT" appears in the remote control unit display. This mode is active for 25 seconds. After this, the display goes back to audio/video. Press the LIGHT key one more time if required.
- Switch the light scenes according to the table below.

 „LIGHT+A“ in the table means that these two keys must be pressed one after the other (not simultaneously).

Function	Keys to be pressed
Call up light scene 1	LIGHT+A
Call up light scene 2	LIGHT+C
Call up light scene 3	LIGHT+D
Call up light scene 4	LIGHT+F
Save light scene 1	LIGHT+ LIST*+GO+A
Save light scene 2	LIGHT+ LIST*+GO+C
Save light scene 3	LIGHT+ LIST*+GO+D
Save light scene 4	LIGHT+ LIST*+GO+F

* The key LIST must be pressed until STORE appears in the display.

7.2.3 Switching off the consumers

When pressing the "STOP" button, all consumers can be switched off with one single button.

8 Installation

8.1 Electric installation

- Busch-Installationsbus® EIB/KNX connection

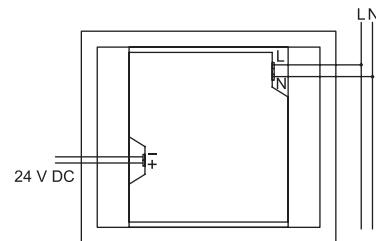


Fig. 62

- Busch Powernet® connection

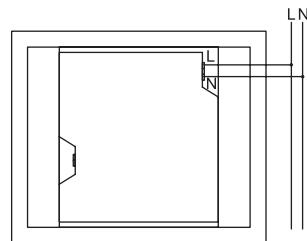


Fig. 63



Do not lay energized lines behind the unit through the flush-mounting box. Separate the TP bus from the mains lines!

8.2 Installation of room/control panel



This unit may only be installed in flush-mounting box 6136/UP.

1. Fit terminals to the lines (230V, TP if required) (see chapter "Connection").
2. Connect terminals to the unit.
3. Insert unit into flush-mounting box and tighten screws (Fig. 64).




Fig. 64

4. Attach the frame and secure it using the enclosed screw (Fig. 65).

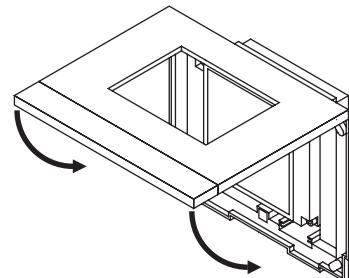


Fig. 65

9 Software

9.1 Installation

ETS 1. Install the panel commissioning software from the current EIB database on a PC.

**(from V.
1.3)** 2. Import the product database into the ETS.
3. Configure the unit and set the parameters.

**Power-
Projekt 4.x** 1. Install the panel commissioning software from the current EIB database or from the Power-
Projekt CD.
2. Configure the unit and set the parameters (see above).



The EIB database can be purchased directly from Busch-Jaeger or downloaded from the Internet at www.busch-jaeger.de.

9.2 Programming

Call up "Commissioning" in the "System" menu.

- See chapter "System settings".
- You may now program the unit using an SD-/MMC card or via the bus.

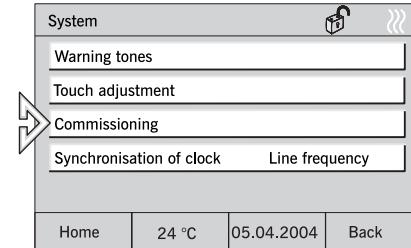


Fig. 66

 Programming via the bus may take several hours, depending on the configuration. Use bus programming only for minor project changes!

We recommend programming with an SD/MMC card!

Programming with SD/MMC card

1. Create the new project with the commissioning software on a PC and save the project on an SD/MMC card.
2. Insert the SD card into the room/control panel and press the "Read Multimedia/SD card" button (Fig. 68).

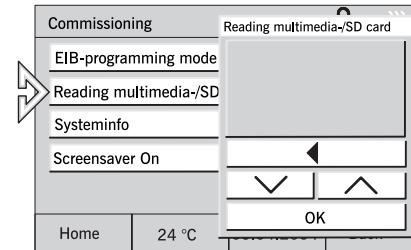


Fig. 67

3. Highlight the project in the project list and press the "OK" button
4. The project is transferred from the SD/MMC card into the room/control panel and starts automatically.
5. The unit exits the programming mode automatically and the basic view is displayed.

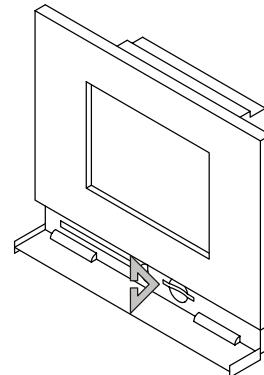


Fig. 68

Programming using the bus

1. Create the new project on a PC.
2. Connect the computer with the bus via an RS 232 or a USB interface.
- 3: Press the "EIB Programming Mode" button and enable it.

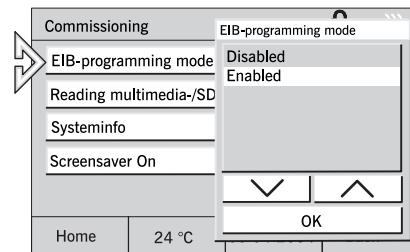


Fig. 69

4. Start programming from the PC.



This process may take several hours.

Screen-saver

During the configuration of the device, the use of pictures as screensavers can be activated (6136/100Cxxx).

In this case, pictures can be transferred to the control panels using an SD/MMC card.

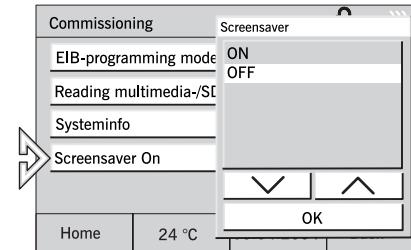


Fig. 70

1. Insert the SD card into the control panel and press the "Screensaver" button (Fig. 70).
2. Select the file from the list and press the "OK" button.
3. Press the "EIB Programming Mode" button and enable it.



Pictures **cannot** be transferred through the bus.

Macro recorder

You can use the macro recorder to record switching process in order to repeat them just like scenes as often as desired.

You can record and save up to 32 macros with 20 switching processes each.

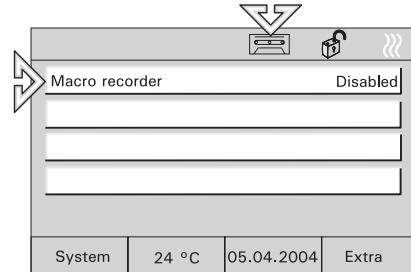


Fig. 71

1. Activate the "Macro recorder" button by pressing the button for more than 3 seconds (cassette icon on the display).
2. Perform the switching processes to be recorded in the desired order.
3. Every switching process to be recorded has to be confirmed with "Yes". Press the button "Yes+Exit" to stop the recording.
4. If you press the button "No" or "No+Exit", the switching process will not be recorded.

Activation

1. Activate the "Macro recorder" button by pressing the button briefly.

Delete

You can change macros by overwriting them.

1. Press selected key and record switching processes as shown above. By pressing the key "No+Exit" without recording any processes the macro is deleted completely.

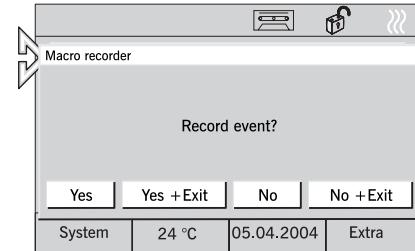


Fig. 72

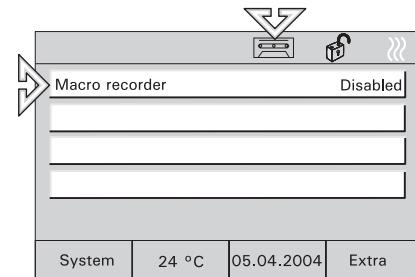


Fig. 73