


BACnet Server BACNET REV. 14 PICS

Supplementary Information

Version 1.0.1

Publication date 2023-08-10

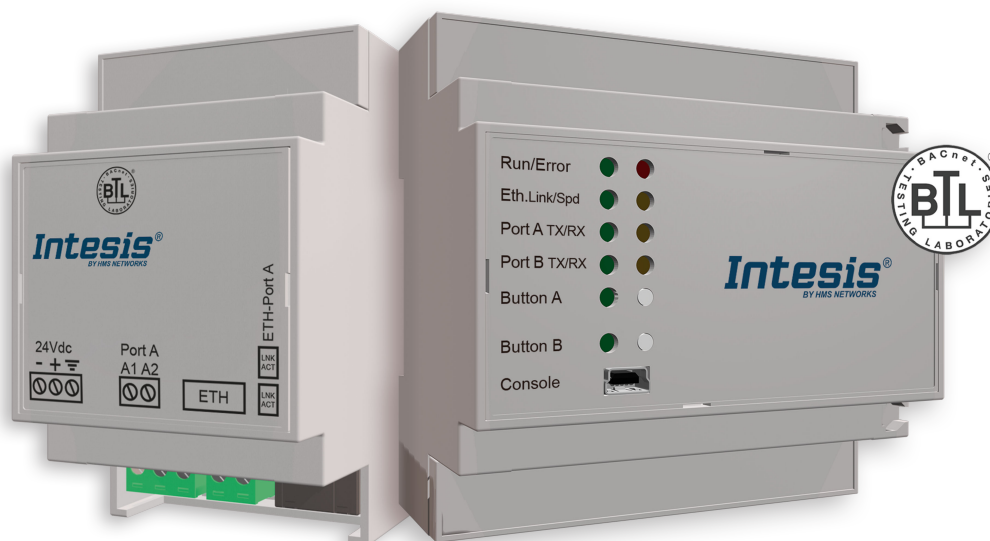

Copyright © 2023 Intesis

Disclaimer

The information in this document is for informational purposes only. Please inform HMS Networks of any inaccuracies or omissions found in this document. HMS Networks disclaims any responsibility or liability for any errors that may appear in this document.

HMS Networks reserves the right to modify its products in line with its policy of continuous product development. The information in this document shall therefore not be construed as a commitment on the part of HMS Networks and is subject to change without notice. HMS Networks makes no commitment to update or keep current the information in this document.

The data, examples and illustrations found in this document are included for illustrative purposes and are only intended to help improve understanding of the functionality and handling of the product. In view of the wide range of possible applications of the product, and because of the many variables and requirements associated with any particular implementation, HMS Networks cannot assume responsibility or liability for actual use based on the data, examples or illustrations included in this document nor for any damages incurred during installation of the product. Those responsible for the use of the product must acquire sufficient knowledge in order to ensure that the product is used correctly in their specific application and that the application meets all performance and safety requirements including any applicable laws, regulations, codes and standards. Further, HMS Networks will under no circumstances assume liability or responsibility for any problems that may arise as a result from the use of undocumented features or functional side effects found outside the documented scope of the product. The effects caused by any direct or indirect use of such aspects of the product are undefined and may include e.g. compatibility issues and stability issues.

Table of Contents

1. Protocol Implementation Conformance Statement	1
1.1. BACnet Standardized Device Profile (Annex L)	1
1.2. Segmentation Capability	1
1.3. Data Link Layer Options	2
1.4. Device Address Binding	2
1.5. Networking Options	2
1.6. Character Sets Supported	2
1.7. Gateway	3
2. BACnet Interoperability Building Blocks Supported (BIBBs)	4
2.1. Data Sharing BIBBs	4
2.2. Alarm and Event Management BIBBs	4
2.3. Scheduling BIBBs	4
2.4. Trending BIBBs	4
2.5. Device Management BIBBs	5
3. Service Types	6
4. Objects	7
4.1. Supported Object Types	7
4.2. Objects and properties	8
4.2.1. IBOX-BAC-*** (Device Object Type)	8
4.2.2. Analog Input Object Type	9
4.2.3. Analog Output Object Type	10
4.2.4. Analog Value Object Type	11
4.2.5. Binary Input Object Type	12
4.2.6. Binary Output Object Type	13
4.2.7. Binary Value Object Type	14
4.2.8. Multistate Input Object Type	15
4.2.9. Multistate Output Object Type	16
4.2.10. Multistate Value Object Type	17
4.2.11. Notification Class Object Type	18
4.2.12. Calendar Object Type	18
4.2.13. Schedule Object Type	18
4.2.14. Trend Log Object Type	19
4.2.15. Trend Log Multiple Object Type	20

1. Protocol Implementation Conformance Statement

Version 1.0.1

BACnet Protocol Implementation Conformance Statement (PICS)

Date: 2022-03-31

Vendor Name: HMS Industrial Networks SLU

Product Name: IntesisBox BACnet Server Series

Product Model Number and Application Software Version: DALI (1.1.3.0) / KNX (1.0.6.0) / Modbus (1.1.4.0) / M-Bus (1.0.10) / Panasonic VRF Systems (1.0.5.0) / Hisense VRF Systems (1.0.2.0) / Hitachi VRF Systems (1.0.3.0) / Samsung NASA VRF Systems (1.0.10.0) / Midea VRF Systems (1.0.2.0) / PROFINET to BACnet/IP & MS/TP (1.0.2.0) / DALI to BACnet/IP (1.1.1.0) / Modbus to BACnet/IP (1.0.2.0) / M-Bus to BACnet/IP (1.0.1.0) / Modbus 2xRS485 to BACnet/IP & MS/TP (1.0.1.0)

Firmware Revision: 14.1.2.0

BACnet Protocol Revision: 14

Product Description:

Provides a BACnet server B-AAC interface that brings connectivity to another BMS network (KNX, Modbus, ...) connected to the device. It provides BACnet MS/TP and BACnet/IP (through Ethernet 10/100) physical layers.

1.1. BACnet Standardized Device Profile (Annex L)

- ☐ BACnet Operator Workstation (B-OWS)
- ☐ BACnet Building Controller (B-BC)
- ☒ BACnet Advanced Application Controller (B-AAC)
- ☐ BACnet Application Specific Controller (B-ASC)
- ☐ BACnet Smart Sensor (B-SS)
- ☐ BACnet Smart Actuator (B-SA)

Additional BACnet Interoperability Building Blocks Supported (Annex K): Reference of BIBBs List.

1.2. Segmentation Capability

Segmented request supported: ☐ No ☒ Yes Window Size · 16 ·

Segmented responses supported: ☐ No ☒ Yes Window Size · 16 ·

1.3. Data Link Layer Options

- ☒ BACnet/IP, (Annex J)
- ☒ BACnet/IP, (Annex J), Foreign Device
- ☐ ISO 8802-3, Ethernet (Clause 7)
- ☐ ANSI/ATA 878.1, 2.5 Mb. ARCNET (Clause 8)
- ☐ ANSI/ATA 878.1, RS-485 ARCNET (Clause 8), baud rate(s) _____
- ☒ MS/TP manager (Clause 9)¹, baud rate(s): 9600, 19200, 38400, 57600, 76800, 115200
- ☐ MS/TP subordinate (Clause 9), baud rate(s): _____
- ☐ Point-To-Point, EIA 232 (Clause 10), baud rate(s): _____
- ☐ Point-To-Point, modem, (Clause 10), baud rate(s): _____
- ☐ LonTalk, (Clause 11), medium: _____
- ☐ Other: _____

1.4. Device Address Binding

Is static device binding supported? (This is currently necessary for two-way communication with MS/TP subordinates and certain other devices). ☐ Yes ☒ No

1.5. Networking Options

- ☐ Router, Clause 6 - List all routing configurations, e.g., ARCNET-Ethernet, Ethernet-MS/TP, etc.
- ☐ Annex H, BACnet Tunneling Router over IP
- ☒ BACnet/IP Broadcast Management Device (BBMD).

Does the BBMD support registrations by Foreign Devices? ☒ Yes ☐ No

1.6. Character Sets Supported

Indicating support for multiple character sets does not imply that they can all be supported simultaneously.

- ☒ ISO 10646 (UTF-8)
- ☐ ISO 10646 (UCS-2)
- ☐ IBM™/Microsoft™ DBCS
- ☐ ISO 10646 (UCS-4)
- ☐ ISO 8859-1
- ☐ JIS X 0208

¹Not available in the BACnet/IP-only models

1.7. Gateway

If this product is a communication gateway, describe the types of non-BACnet equipment/network(s) that the gateway supports:

Modbus RTU and/or TCP.

KNX TP-1 networks.

M-Bus.

LONworks.

Ethernet/IP.

Profinet.

and multiple AC manufacturers (Panasonic, Samsung, Midea and many others).

2. BACnet Interoperability Building Blocks Supported (BIBBs)

2.1. Data Sharing BIBBs

BIBB Type		BACnet Service	Initiate	Execute
DS-RP-B	Data Sharing-ReadProperty-B	ReadProperty	☐	☒
DS-RPM-B	Data Sharing-ReadPropertyMultiple-B	ReadPropertyMultiple	☐	☒
DS-WP-B	Data Sharing-WriteProperty-B	WriteProperty	☐	☒
DS-WPM-B	Data Sharing-WritePropertyMultiple-B	WritePropertyMultiple	☐	☒
DS-COV-B	Data Sharing COV-B	SubscribeCOV	☐	☒
		ConfirmedCOVNotification	☒	☐
		UnconfirmedCOVNotification	☒	☐

2.2. Alarm and Event Management BIBBs

BIBB Type		BACnet Service	Initiate	Execute
AE-N-I-B	Alarm and Event-Notification Internal-B	ConfirmedEventNotification	☒	☐
		UnconfirmedEventNotification	☒	☐
AE-ACK-B	Alarm and Event-ACK-B	AcknowledgeAlarm	☐	☒
AE-ASUM-B	Alarm and Event-Alarm Summary-B	GetAlarmSummary	☐	☒
AE-INFO-B	Alarm and Event-Information-B	GetEventInformation	☐	☒

2.3. Scheduling BIBBs

BIBB Type		BACnet Service	Initiate	Execute
SCHED-I-B	Scheduling-Internal-B			

2.4. Trending BIBBs

BIBB Type		BACnet Service	Initiate	Execute
T-VMT-I-B	Trending - Viewing and Modifying Trends Internal-B	ReadRange	☐	☒
T-VMMV-I-B	Trending - Viewing and Modifying Multiple Values Internal-B	ConfirmedEventNotification	☐	☒
		ReadRange	☒	☐

2.5. Device Management BIBBs

BIBB Type		BACnet Service	Initiate	Execute
DM-DDB-A	Device Management - Dynamic Device Binding-A	Who-Is	☒	☐
		I-Am	☐	☒
DM-DDB-B	Device Management - Dynamic Device Binding-B	Who-Is	☐	☒
		I-Am	☒	☐
DM-DOB-B	Device Management - Dynamic Object Binding-B	Who-Has	☐	☒
		I-Have	☒	☐
DM-DCC-B	Device Management - DeviceCommunicationControl-B	DeviceCommunicationControl	☐	☒
DM-TS-B	Device Management - TimeSynchronization-B	TimeSynchronization	☐	☒
DM-RD-B	Device Management-ReinitializeDevice-B	ReinitializeDevice	☐	☒

3. Service Types

Service type	Service name	Remarks
Alarm and Event Services	AcknowledgeAlarm	Execute
	ConfirmedCOVNotification	Initiate
	ConfirmedEventNotification	Initiate
	GetAlarmSummary	Execute
	SubscribeCOV	Execute
Object Access Services	ReadProperty	Execute
	ReadPropertyMultiple	Execute
	ReadRange	Execute
	WriteProperty	Execute
	WritePropertyMultiple	Execute
Remote Device Management Services	DeviceCommunicationControl	Execute
	ReinitializeDevice	Execute
Unconfirmed Services	I-Am	Execute / Initiate
	I-Have	Initiate
	UnconfirmedCOVNotification	Initiate
	UnconfirmedEventNotification	Initiate
	TimeSynchronization	Execute
	Who-Has	Execute
	Who-Is	Execute / Initiate
	GetEventInformation	Execute

4. Objects

4.1. Supported Object Types

Object Type	ID
Analog-Input	0
Analog-Output	1
Analog-Value	2
Binary-Input	3
Binary-Output	4
Binary-Value	5
Calendar	6
Device	8
Multistate-Input	13
Multistate-Output	14
Multistate-Value	19
Notification-Class	15
Schedule	17
Trend-Log	20
Trend-Log-Multiple	27

4.2. Objects and properties

4.2.1. IBOX-BAC-*** (Device Object Type)

Property identifier	Property datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Device, 246)	R	W
Object_Name	CharacterString	Configurable through BACnet and Config Tool	R	W
Object_Type	BACnetObjectType	DEVICE (8) (Device Object Type)	R	R
System_Status	BACnetDeviceStatus	OPERATIONAL (0)	R	R
Vendor_Name	CharacterString	"Intesis Software, SLU"	R	R
Vendor_Identifier	Unsigned16	246	R	R
Model_Name	CharacterString	"IBOX-BAC-***"	R	R
Description	CharacterString	It varies per gateway, e.g. "Modbus to BACnet Gateway"	O	R
Firmware_Revision	CharacterString	"14.1.2.0"	R	R
Application_Software_Version	CharacterString	"1.x.x.x"	R	R
Protocol_Version	Unsigned	1	R	R
Protocol_Revision	Unsigned	14	R	R
Protocol_Services_Supported	BACnetServiceSupported	Refer to Section 3 [Service Types]	R	R
Protocol_Object_Types_Supported	BACnetObjectTypesSupported	Refer to Section 4. [Object Types]	R	R
Object_List	BACnetArray[N] of BACnetObjectIdentifier	BACnetARRAY[N]	R	R
Max_APDU_Length_Accepted	Unsigned	480 when MS/TP / 1476 when BACnet/IP	R	R
Segmentation_Supported	BACnetSegmentation	SEGMENTED-BOTH (0)	R	R
Max_Segments_accepted	Unsigned	16	O	R
Local_Time	Time	Current time	O	R
Local_Date	Date	Current date	O	R
APDU_Segment_Timeout	Unsigned	3000	R	R
APDU_Timeout	Unsigned	3000	R	R
Number_of_APDU_Retries	Unsigned	3	R	R
UTC_Offset	INTEGER	-	O	R
Daylight_Savings_Status	BOOLEAN	-	O	R
Device_Address_Binding	List of BACnetAddressBinding	NULL (empty)	R	R
Database_Revision	Unsigned	""	R	R
Active_COV_Subscriptions	List of BACnetCOVSubscription	List of BACnetCOVSubscription	O	R
Serial_Number	CharacterString	""	O	R
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R
Max_Master ^{1,2}	Unsigned	127	R	W
Max_Info_Frames ¹	Unsigned	1	O	R

¹Only available when MS/TP is used.

²Configurable through the configuration tool

4.2.2. Analog Input Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Analog Input, 0)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	ANALOG_INPUT (0)	R	R
Present_Value	REAL	x	R	R
Description	CharacterString	Configurable through Config Tool	O	R ¹
Status_Flags	BACnetStatusFlags	{FALSE, FALSE/TRUE, FALSE, FALSE}	R	R
Event_State	BACnetEventState	STATE_NORMAL (0)	R	R
Reliability	BACnetReliability	NO_FAULT_DETECTED (0), UNRELIABLE_OTHER (7)	O	R
Out_Of_Service	BOOLEAN	FALSE	R	R
Units	BACnetEngineeringUnits	Configurable through Config Tool	R	R
COV_Increment	REAL	0	O	W
Time_Delay	Unsigned	-	O	R ²
Notification_Class	Unsigned	-	O	R ²
High_Limit	REAL	-	O	R ²
Low_Limit	REAL	-	O	R ²
Deadband	REAL	-	O	R ²
Limit_Enable	BACnetLimitEnable	-	O	R ²
Event_Enable	BACnetEventTransitionBits	{TRUE, TRUE, TRUE}	O	R ²
Acked_Transitions	BACnetEventTransitionBits	-	O	R ²
Notify_Type	BACnetNotifyType	-	O	R ²
Event_Time_Stamps	BACnetArray[N] of BACnetTimeStamp	-	O	R ²
Event_Detection_Enable	BOOLEAN	-	O	R
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

¹Available only in some models after activation on the configuration tool; check the specific model manual for details.

²Available only when the specific object has a Notification Class configured.

4.2.3. Analog Output Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Analog Output, 0)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	ANALOG_OUTPUT (1)	R	R
Present_Value	REAL	x	W	W
Description	CharacterString	Configurable through Config Tool	O	R ¹
Status_Flags	BACnetStatusFlags	{FALSE, FALSE, FALSE, FALSE}	R	R
Event_State	BACnetEventState	STATE_NORMAL (0)	R	R
Reliability	BACnetReliability	NO_FAULT_DETECTED (0)	O	R
Out_Of_Service	BOOLEAN	FALSE	R	R
Units	BACnetEngineeringUnits	Configurable through Config Tool	R	R
Priority_Array	BACnetPriorityArray	BACnetPriorityArray	R	R
Relinquish_Default	Unsigned	Configurable through BACnet and Config Tool	W	W
COV_Increment	REAL	0	O	W
Time_Delay	Unsigned	-	O	R ²
Notification_Class	Unsigned	-	O	R ²
High_Limit	REAL	-	O	R ²
Low_Limit	REAL	-	O	R ²
Deadband	REAL	-	O	R ²
Limit_Enable	BACnetLimitEnable	-	O	R ²
Event_Enable	BACnetEventTransitionBits	{TRUE, TRUE, TRUE}	O	R ²
Acked_Transitions	BACnetEventTransitionBits	-	O	R ²
Notify_Type	BACnetNotifyType	-	O	R ²
Event_Time_Stamps	BACnetArray[N] of BACnetTimeStamp	-	O	R ²
Event_Detection_Enable	BOOLEAN	-	O	R
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

¹Available only in some models after activation on the configuration tool; check the specific model manual for details.

²Available only when the specific object has a Notification Class configured.

4.2.4. Analog Value Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Analog Value, 0)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	ANALOG_VALUE (2)	R	R
Present_Value	REAL	x	R	W
Description	CharacterString	Configurable through Config Tool	O	R ¹
Status_Flags	BACnetStatusFlags	{FALSE, FALSE, FALSE, FALSE}	R	R
Event_State	BACnetEventState	STATE_NORMAL (0)	R	R
Reliability	BACnetReliability	NO_FAULT_DETECTED (0)	O	R
Out_Of_Service	BOOLEAN	FALSE	R	R
Units	BACnetEngineeringUnits	Configurable through Config Tool	R	R
COV_Increment	REAL	0	O	W
Time_Delay	Unsigned	-	O	R ²
Notification_Class	Unsigned	-	O	R ²
High_Limit	REAL	-	O	R ²
Low_Limit	REAL	-	O	R ²
Deadband	REAL	-	O	R ²
Limit_Enable	BACnetLimitEnable	-	O	R ²
Event_Enable	BACnetEventTransitionBits	{TRUE, TRUE, TRUE}	O	R ²
Acked_Transitions	BACnetEventTransitionBits	-	O	R ²
Notify_Type	BACnetNotifyType	-	O	R ²
Event_Time_Stamps	BACnetArray[N] of BACnetTimeStamp	-	O	R ²
Event_Detection_Enable	BOOLEAN	-	O	R
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

¹Available only in some models after activation on the configuration tool; check the specific model manual for details.

²Available only when the specific object has a Notification Class configured.

4.2.5. Binary Input Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Binary Input, 0)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	BINARY_INPUT (3)	R	R
Present_Value	BACnetBinaryPV	INACTIVE (0) / ACTIVE (1)	R	R
Description	CharacterString	Configurable through Config Tool	O	R ¹
Status_Flags	BACnetStatusFlags	{FALSE, FALSE/TRUE, FALSE, FALSE}	R	R
Event_State	BACnetEventState	STATE_NORMAL (0)	R	R
Reliability	BACnetReliability	NO_FAULT_DETECTED (0), UNRELIABLE_OTHER(7)	O	R
Out_Of_Service	BOOLEAN	FALSE	R	R
Polarity	BACnetPolarity	NORMAL (0)	R	R
Inactive_Text	CharacterString	Configurable through Config Tool	O	R
Active_Text	CharacterString	Configurable through Config Tool	O	R
Time_Delay	Unsigned	-	O	R ²
Notification_Class	Unsigned	-	O	R ²
Alarm_Value	BACnetBinaryPV	-	O	R ²
Event_Enable	BACnetEventTransitionBits	-	O	R ²
Acked_Transitions	BACnetEventTransitionBits	-	O	R ²
Notify_Type	BACnetNotifyType	-	O	R ²
Event_Time_Stamps	BACnetArray[N] of BACnetTimeStamp	-	O	R ²
Event_Detection_Enable	BOOLEAN	-	O	R
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

¹Available only in some models after activation on the configuration tool; check the specific model manual for details.

²Available only when the specific object has a Notification Class configured.

4.2.6. Binary Output Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Binary Output, 0)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	BINARY_OUTPUT (4)	R	R
Present_Value	BACnetBinaryPV	INACTIVE (0) / ACTIVE (1)	W	W
Description	CharacterString	Configurable through Config Tool	O	R ¹
Status_Flags	BACnetStatusFlags	{FALSE, FALSE, FALSE, FALSE}	R	R
Event_State	BACnetEventState	STATE_NORMAL (0)	R	R
Reliability	BACnetReliability	NO_FAULT_DETECTED (0)	O	R
Out_Of_Service	BOOLEAN	FALSE	R	R
Polarity	BACnetPolarity	NORMAL (0)	R	R
Inactive_Text	CharacterString	Configurable through Config Tool	O	R
Active_Text	CharacterString	Configurable through Config Tool	O	R
Priority_Array	BACnetPriorityArray	BACnetPriorityArray	R	R
Relinquish_Default	BACnetBinaryPV	INACTIVE (0)	R	W
Time_Delay	Unsigned	-	O	R ²
Notification_Class	Unsigned	-	O	R ²
Event_Enable	BACnetEventTransitionBits	{TRUE, TRUE, TRUE}	O	R ²
Feedback_Value	BACnetBinaryPV	-	O	W
Acked_Transitions	BACnetEventTransitionBits	-	O	R ²
Notify_Type	BACnetNotifyType	-	O	R ²
Event_Time_Stamps	BACnetArray[N] of BACnetTimeStamp	-	O	R ²
Event_Detection_Enable	BOOLEAN	-	O	R
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

¹Available only in some models after activation on the configuration tool; check the specific model manual for details.

²Available only when the specific object has a Notification Class configured.

4.2.7. Binary Value Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Binary Value, 0)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	BINARY_VALUE (5)	R	R
Present_Value	BACnetBinaryPV	INACTIVE (0) / ACTIVE (1)	W	W
Description	CharacterString	Configurable through Config Tool	O	R ¹
Status_Flags	BACnetStatusFlags	{FALSE, FALSE, FALSE, FALSE}	R	R
Event_State	BACnetEventState	STATE_NORMAL (0)	R	R
Reliability	BACnetReliability	NO_FAULT_DETECTED (0)	O	R
Out_Of_Service	BOOLEAN	FALSE	R	R
Inactive_Text	CharacterString	Configurable through Config Tool	O	R
Active_Text	CharacterString	Configurable through Config Tool	O	R
Time_Delay	Unsigned	-	O	R ²
Notification_Class	Unsigned	-	O	R ²
Alarm_Value	BACnetBinaryPV	-	O	R ²
Event_Enable	BACnetEventTransitionBits	-	O	R ²
Acked_Transitions	BACnetEventTransitionBits	-	O	R ²
Notify_Type	BACnetNotifyType	-	O	R ²
Event_Time_Stamps	BACnetArray[N] of BACnetTimeStamp	-	O	R ²
Event_Detection_Enable	BOOLEAN	-	O	R
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

¹Available only in some models after activation on the configuration tool; check the specific model manual for details.

²Available only when the specific object has a Notification Class configured.

4.2.8. Multistate Input Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Multi-state Input, 0)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	MULTISTATE_INPUT (13)	R	R
Present_Value	Unsigned	-	R	R
Description	CharacterString	Configurable through Config Tool	O	R ¹
Status_Flags	BACnetStatusFlags	{FALSE, FALSE/TRUE, FALSE, FALSE}	R	R
Event_State	BACnetEventState	STATE_NORMAL (0)	R	R
Reliability	BACnetReliability	NO_FAULT_DETECTED (0), UNRELIABLE_OTHER (7)	O	R
Out_Of_Service	BOOLEAN	FALSE	R	R
Number_Of_States	Unsigned	Configurable through Config Tool	R	R
State_Text	BACnetArray[N] of CharacterString	Configurable through Config Tool	O	R
Time_Delay	Unsigned	-	O	R ²
Notification_Class	Unsigned	-	O	R ²
Alarm_Values	List of Unsigned	-	O	R ²
Fault_Values	List of Unsigned	-	O	R ²
Event_Enable	BACnetEventTransitionBits	-	O	R ²
Acked_Transitions	BACnetEventTransitionBits	-	O	R ²
Notify_Type	BACnetNotifyType	-	O	R ²
Event_Time_Stamps	BACnetArray[N] of BACnetTimeStamp	-	O	R ²
Event_Detection_Enable	BOOLEAN	-	O	R
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

¹Available only in some models after activation on the configuration tool; check the specific model manual for details.

²Available only when the specific object has a Notification Class configured.

4.2.9. Multistate Output Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Multi-state Output, 0)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	MULTISTATE_OUTPUT (14)	R	R
Present_Value	Unsigned	-	W	W
Description	CharacterString	Configurable through Config Tool	O	R ¹
Status_Flags	BACnetStatusFlags	{FALSE, FALSE, FALSE, FALSE}	R	R
Event_State	BACnetEventState	STATE_NORMAL (0)	R	R
Reliability	BACnetReliability	NO_FAULT_DETECTED (0)	O	R
Out_Of_Service	BOOLEAN	FALSE	R	R
Number_Of_States	Unsigned	Configurable through Config Tool	R	R
State_Text	BACnetArray[N] of CharacterString	Configurable through Config Tool	O	R
Priority_Array	BACnetPriorityArray	BACnetPriorityArray	R	R
Relinquish_Default	Unsigned	1	W	W
Time_Delay	Unsigned	-	O	R ²
Notification_Class	Unsigned	-	O	R ²
Feedback_Value	Unsigned	-	O	R
Event_Enable	BACnetEventTransitionBits	{TRUE, TRUE, TRUE}	O	R ²
Acked_Transitions	BACnetEventTransitionBits	-	O	R ²
Notify_Type	BACnetNotifyType	-	O	R ²
Event_Time_Stamps	BACnetArray[N] of BACnetTimeStamp	-	O	R ²
Event_Detection_Enable	BOOLEAN	-	O	R
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

¹Available only in some models after activation on the configuration tool; check the specific model manual for details.

²Available only when the specific object has a Notification Class configured.

4.2.10. Multistate Value Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Multi-state Output, 0)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	MULTISTATE_VALUE (19)	R	R
Present_Value	Unsigned	-	W	W
Description	CharacterString	Configurable through Config Tool	O	R ¹
Number_Of_States	Unsigned	Configurable through Config Tool	R	R
Status_Flags	BACnetStatusFlags	{FALSE, FALSE, FALSE, FALSE}	R	R
Event_State	BACnetEventState	STATE_NORMAL (0)	R	R
Reliability	BACnetReliability	NO_FAULT_DETECTED (0)	O	R
Out_Of_Service	BOOLEAN	FALSE	R	R
State_Text	BACnetArray[N] of CharacterString	Configurable through Config Tool	O	R
Time_Delay	Unsigned	-	O	R ²
Notification_Class	Unsigned	-	O	R ²
Alarm_Values	Unsigned	-	O	R ²
Fault_Values	Unsigned	-	O	R ²
Event_Enable	BACnetEventTransitionBits	{TRUE, TRUE, TRUE}	O	R ²
Acked_Transitions	BACnetEventTransitionBits	-	O	R ²
Notify_Type	BACnetNotifyType	-	O	R ²
Event_Time_Stamps	BACnetArray[N] of BACnetTimeStamp	-	O	R ²
Event_Detection_Enable	BOOLEAN	-	O	R
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

¹Available only in some models after activation on the configuration tool; check the specific model manual for details.

²Available only when the specific object has a Notification Class configured.

4.2.11. Notification Class Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Notification_Class, 1)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	NOTIFICATION_CLASS (15)	R	R
Notification_Class	Unsigned	-	R	R
Priority	BACnetARRAY[3] of Unsigned	{1, 2, 3}	R	R
Ack_Required	BACnetEventTransitionBits	-	R	R
Recipient_List	BACnetLIST of BACnetDestination	-	R	W
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

4.2.12. Calendar Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Calendar, 0)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	CALENDAR(6)	R	R
Present_Value	BOOLEAN	-	R	R
Date_List	BACnetLIST of BACnetCalendarEntry	-	R	W
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

4.2.13. Schedule Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Schedule, 0)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	SCHEDULE(17)	R	R
Present_Value	Any	-	R	R
Effective_Period	BACnetDateRange	-	R	W
Weekly_Schedule	BACnetARRAY[7] of BACnetDailySchedule	-	R	W
Exception_Schedule	BACnetARRAY[N] of BACnetSpecialEvent	-	R	W
Schedule_Default	Any	-	R	W
List_Of_Object_Property_References	BACnetLIST of BACnetDeviceObjectPropertyReference	-	R	R
Priority_For_Writing	Unsigned (1..16)	-	R	W
Status_Flags	BACnetStatusFlags	-	R	R
Reliability	BACnetReliability	-	R	R
Out_Of_Service	BOOLEAN	FALSE	W	W
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

4.2.14. Trend Log Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Trend_Log, 0)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	TREND_LOG (20)	R	R
Enable	BOOLEAN	-	R	W
Start_Time	BACnetDateTime	-	O	W
Stop_Time	BACnetDateTime	-	O	W
Stop_When_Full	BOOLEAN	Configurable through Config Tool	R	R
Buffer_Size	Unsigned	2880	R	R
Log_Buffer	List of BACnetLogRecord	-	R	R
Record_Count	Unsigned	-	R	W
Total_Record_Count	Unsigned	-	R	R
Event_State	BACnetEventState	-	R	R
Logging_Type	BACnetLoggingType	-	R	R
Status_Flags	BACnetStatusFlags	-	R	R
Trigger	BOOLEAN	-		W
Client_COV_Increment	BACnetClientCOV	-	O	W
Log_Device_Object_Property	BACnetDeviceObjectPropertyReference	-	O	R
Log_Interval	Unsigned	-	O	W
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R

4.2.15. Trend Log Multiple Object Type

Property Identifier	Property Datatype	Value	ASHRAE	Gateway
Object_Identifier	BACnetObjectIdentifier	(Trend_Log_Multiple, 1)	R	R
Object_Name	CharacterString	Configurable through Config Tool	R	R
Object_Type	BACnetObjectType	TREND_LOG_MULTIPLE (27)	R	R
Enable	BOOLEAN	-	R	W
Start_Time	BACnetDateTime	-	O	W
Stop_Time	BACnetDateTime	-	O	W
Log_Device_Object_Property	BACnetARRAY[10] of BACnetDeviceObjectPropertyReference	-	O	R
Stop_When_Full	BOOLEAN	Configurable through Config Tool	R	R
Buffer_Size	Unsigned	2880	R	R
Log_Buffer	List of BACnetLogRecord	-	R	R
Record_Count	Unsigned	-	R	W
Total_Record_Count	Unsigned	-	R	R
Event_State	BACnetEventState	-	R	R
Logging_Type	BACnetLoggingType	-	R	R
Status_Flags	BACnetStatusFlags	-	R	R
Log_Interval	Unsigned	-	R	W
Trigger	BOOLEAN	-	O	R
Property_List	BACnetARRAY[N] of BACnetPropertyIdentifier	-	R	R