



700series
Air

Application Wiring Diagrams for IN776MHI



Choose your application

MITSUBISHI
HEAVY INDUSTRIES, LTD.

ASHRAE **BACnet**

IN-BAC-MH
Mitsubishi Heavy Industries
to BACnet

MITSUBISHI
HEAVY INDUSTRIES, LTD.

Modbus

IN-MBS-MH
Mitsubishi Heavy Industries
to Modbus Server

MITSUBISHI
HEAVY INDUSTRIES, LTD.

KNX

IN-KNX-MH
Mitsubishi Heavy Industries
to KNX

MITSUBISHI
HEAVY INDUSTRIES, LTD.

Home Automation

IN-WMP-MH
Mitsubishi Heavy Industries
to Home Automation

Mitsubishi Heavy Industries VRF with KNX,
Serial and IP support



IN-BAC-MH


Mitsubishi Heavy Industries to BACnet



 **700series**
Air



Wiring Diagram

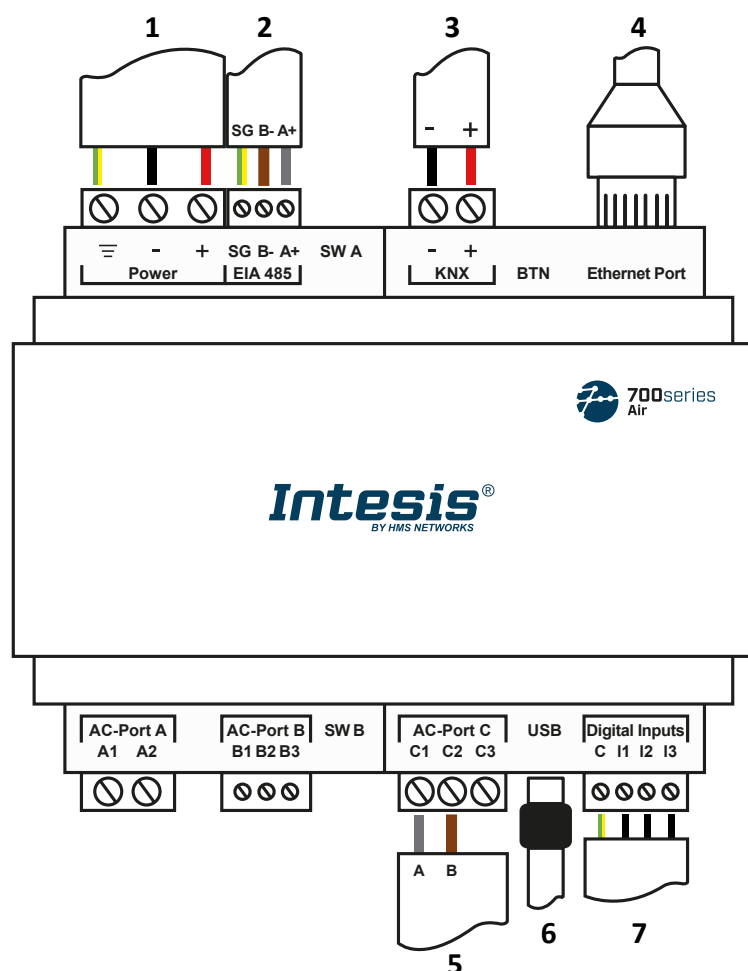

[Application
web page](#)

[User
manual](#)

[Back](#)

- 1. Power Supply (12-36VDC / 24VAC)
- 2. BACnet MSTP
- 3. Not used
- 4. BACnet IP & Console
- 5. Mitsubishi Heavy (Superlink)
- 6. Console
- 7. *Binary inputs (dry contact)
optional



IN-KNX-MH


Mitsubishi Heavy Industries to KNX



700series
Air



Wiring Diagram

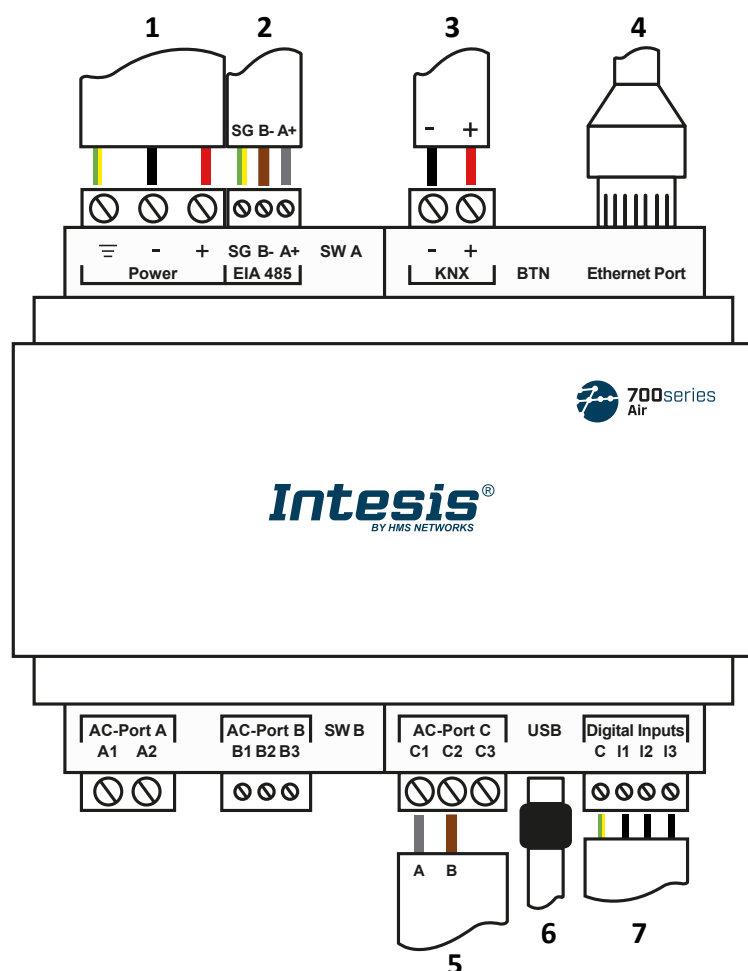

[Application
web page](#)

[User
manual](#)

[Back](#)

- 1. Power Supply (12-36VDC / 24VAC)
- 2. Not used
- 3. KNX
- 4. Console
- 5. Mitsubishi Heavy (Superlink)
- 6. Console
- 7. *Binary inputs (dry contact) optional



IN-MBS-MH

Mitsubishi Heavy Industries to Modbus Server




[BMS]



700series
Air



Wiring Diagram

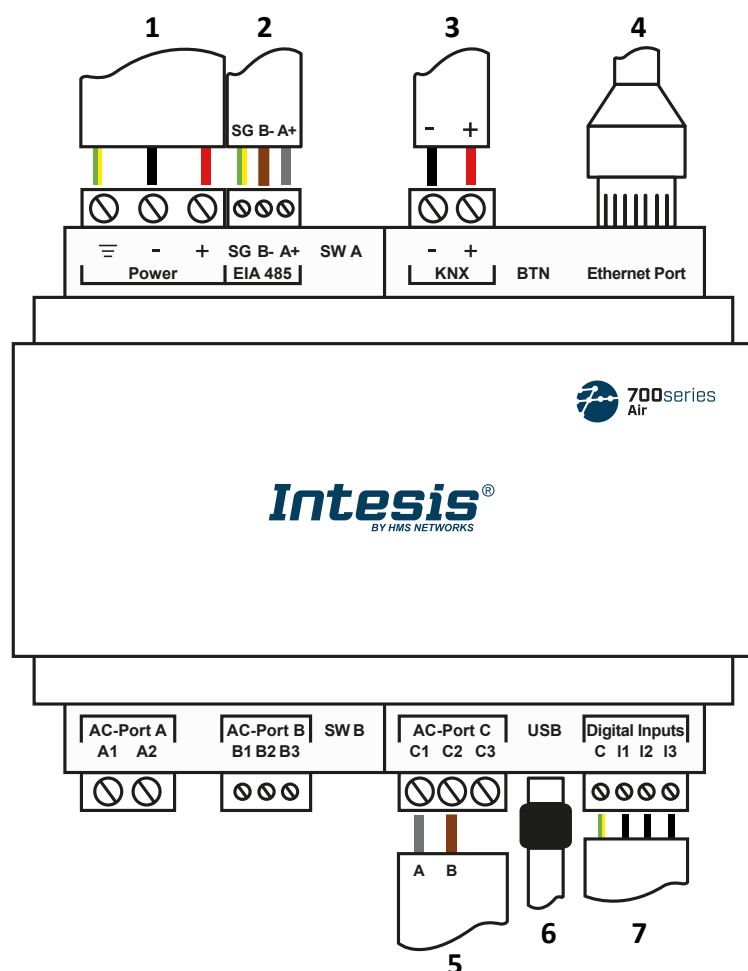

[Application
web page](#)

[User
manual](#)

[Back](#)

- 1. Power Supply (12-36VDC / 24VAC)
- 2. Modbus RTU
- 3. Not used
- 4. Modbus TCP & Console
- 5. Mitsubishi Heavy (Superlink)
- 6. Console
- 7. *Binary inputs (dry contact)
optional



IN-WMP-MH

Mitsubishi Heavy Industries to Home Automation




 **Home
Automation**
[BMS]

 **700series
Air**



Wiring Diagram

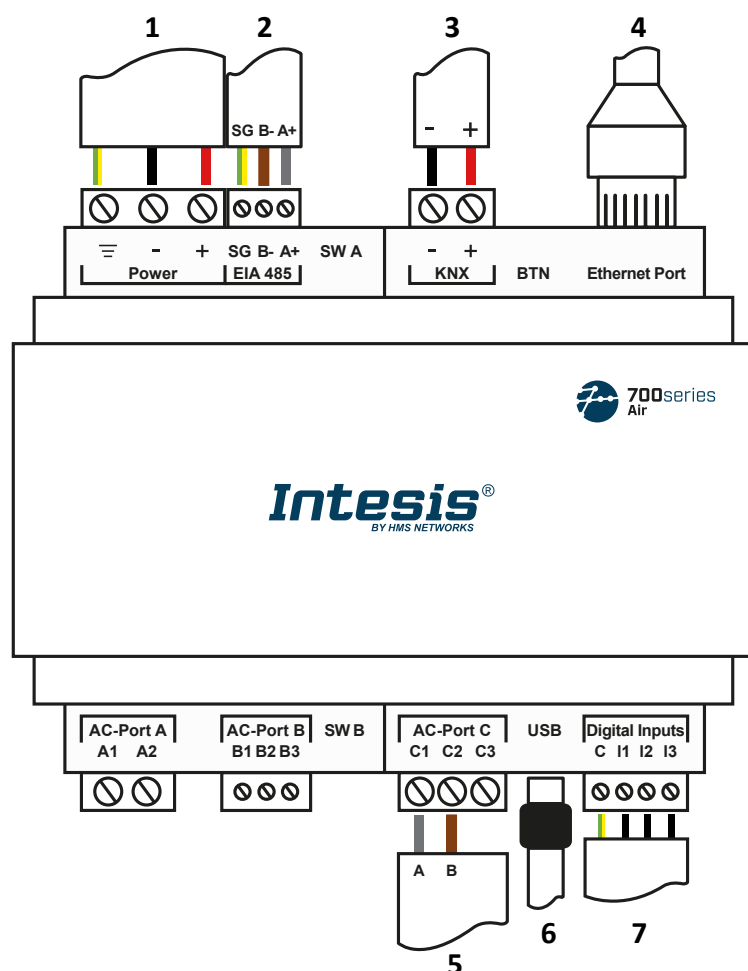

[Application
web page](#)

[User
manual](#)

[Back](#)

- 1. Power Supply (12-36VDC / 24VAC)
- 2. Not used
- 3. Not used
- 4. Home Automation & Console
- 5. Mitsubishi Heavy (Superlink)
- 6. Console
- 7. *Binary inputs (dry contact) optional

