


Line coupler S KNX

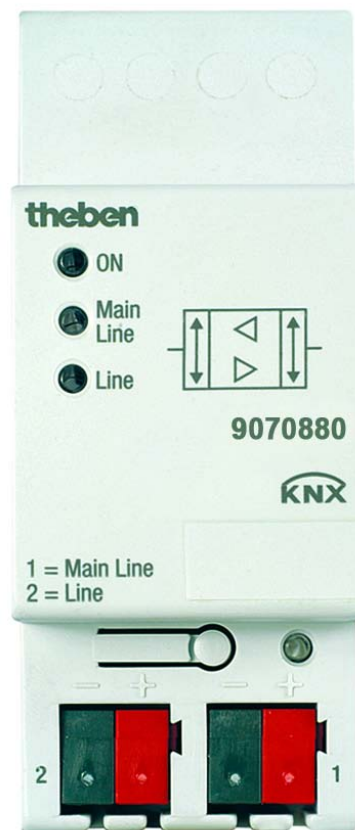

Line coupler S KNX	9070880
--------------------	---------

Line coupler S KNX

Contents

Contents		Page
1	General.....	3
1.1	Using the product manual.....	3
1.1.1	Structure of the product manual.....	3
1.1.2	Notes	4
1.2	Product and functional overview	5
1.2.1	Line/area coupler	5
1.2.2	Repeater.....	7
2	Device technology.....	9
2.1	Technical data	9
2.2	Circuit diagram.....	12
2.3	Dimension drawing	13
2.4	Assembly and installation	14
2.4.1	Display elements	15
3	Commissioning	17
3.1	Overview.....	17
3.2	Parameters	18
3.2.1	Application for ETS 4.....	18
3.2.1.1	Parameter window <i>General</i>	19
3.2.1.2	Device function - <i>Line/Area Coupler</i>	20
3.2.1.2.1	Parameter window <i>Main line --> Line</i>	20
3.2.1.2.2	Parameter window <i>Line --> Main line</i>	23
3.2.1.3	Device function <i>Repeater</i>	24
3.2.1.3.1	Parameter window <i>Settings</i>	24
3.2.2	Applications for the ETS 3	25
3.2.2.1	Application <i>Couple/1.x</i> , parameter window <i>Settings</i>	25
3.2.2.2	Application <i>Repeat/1x</i>	27
3.2.2.2.1	Parameter window <i>Settings</i>	27
A	Appendix.....	29
A.1	Scope of delivery	29
4	Manual.....	30

Line coupler S

General

1 General

The Theben Line Coupler S KNX is a modular installation device with a module width of 2 space units. It is used as a line or area coupler or as a repeater. As a line coupler, the Line coupler S connects a line with a main line, as an area coupler it connects a main line with an area line. It provides electrical isolation in this way.

1.1 Using the product manual

This manual provides you with detailed technical information relating to the function, installation and programming of the Line Coupler. The application of the device is explained using examples.

The manual is divided into the following sections:

- Chapter 1 General
- Chapter 2 Device technology
- Chapter 3 Commissioning
- Chapter A Appendix

1.1.1 Structure of the product manual

Application programs with different ranges of functions can be loaded in the line couple S.

For this reason, all the parameters and functions for ETS 4 and also for ETS 3 are explained in chapter 3.

Note

Different application programs are available with the line coupler S for ETS 3 and ETS 4. Some of the functions for the ETS 4 are not available in the applications for the ETS 3, see [Overview](#), page 17.

In ETS 3, there is a separate application for coupling and for repeating (*Couple/1.x* or *Repeat/1.x*), in ETS 4, there is a common application (*Couple Repeat/2.x*).

All applications are upwards compatible, i.e.:

- The old applications of line coupler can be loaded in the line coupler S (ETS 3). This is particularly useful if in an existing project an line coupler has to be replaced by an line coupler S.
- The applications *Couple/1.x* or *Repeat/1.x* can be loaded in the line coupler S via the ETS 3 or the ETS 4.
- The new application *Couple Repeat/2.x* with extended functional range is only available for the ETS 4.

Line coupler S

General

1.1.2

Notes


Notes and safety instructions are represented as follows in this manual:


Note
Tips for usage and operation

Examples
Application examples, installation examples, programming examples

Important
These safety instructions are used as soon as there is danger of a malfunction without risk of damage or injury.

Caution
These safety instructions are used as soon as there is danger of a malfunction without risk of damage or injury.

 Danger
These safety instructions are used if there is a danger for life and limb with inappropriate use.

 Danger
These safety instructions are used if there is a danger to life with inappropriate use.

Line coupler S

General

1.2 Product and functional overview

The Line Coupler Line Coupler S can be used as a line/area coupler or as a repeater.

1.2.1 Line/area coupler

As a line/area coupler, the Line Coupler S connects the data flow of two lines but isolates them electrically.

The coupler can route physically addressed, group addressed as well as broadcast telegrams.

In order to route a physically addressed telegram, the Line Coupler S compares the target address with its own physical address. The physical address of the Line Coupler S determines the line affiliation. The telegrams are routed or not routed depending on the evaluation and parameterization.

If the Line Coupler S has not yet received its intended project-assigned physical address, this can cause device faults during commissioning.

The Line Coupler S responds in accordance with its parameterization to telegrams with group addresses.

In order to reduce the telegram traffic, the Line Coupler S only routes telegrams in normal operation (standard settings), whose group addresses have been entered in its filter table. However, it can be useful, particularly during commissioning and for diagnostic purposes, to set the option *route* for both parameters *Group telegrams main group 0...13* and *Group telegrams main group 14...31*, i.e. the filter table is switched off. If the system is fully in operation, both parameters should be reset again to the standard values. The Line Coupler S is then subsequently reprogrammed with the application. Here the correct filter table will be transferred to the Line Coupler S.

Note
The application <i>Couple Repeat/2.x</i> for the ETS 4 filters the main groups 14...31. With the application <i>Couple/1.x</i> , no filter table is calculated by the ETS 3 for the main groups 14...31. For this reason, the main groups 14...31 should not be used. If this is necessary, the parameter <i>Main group 14...31</i> must be set with the option <i>route</i> .

If the Line Coupler S routes a telegram and does not receive an acknowledgement or there is a transmission error, the Line Coupler S repeats the telegram up to three times. With the parameters *In case of errors repeat group telegrams*, the response for both lines is set separately. This parameter should be left as it is in the standard setting.


Normally the Line Coupler S only acknowledges telegrams that it routes. The parameter *Telegram confirmation...* facilitates separate acknowledgement settings for both lines. This parameter should be left as it is in the standard setting.

Line coupler S

General

Topology

As a line coupler, the device connects a line with a main line. As an area coupler, the line coupler S connects a main line with an area line. Each line requires its own power supply.

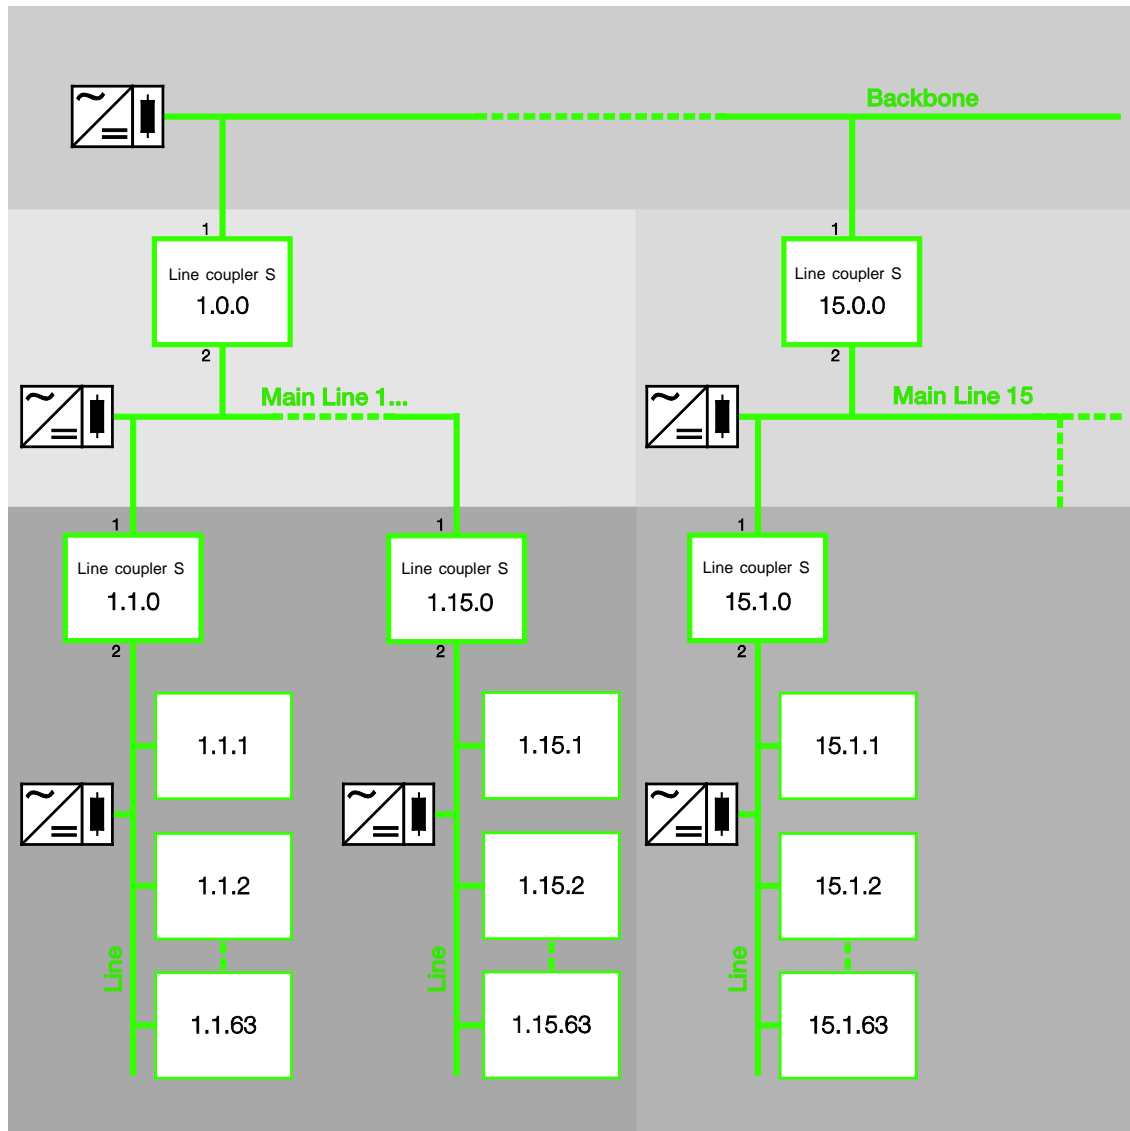

Backbone = Area line with up to 15 area couplers, physical address x.0.0

Main Line = Main line with up to 15 line couplers, physical address x.y.0

Line = Line with up to 64 devices including the line coupler. Up to 256 devices are possible when up to three line repeaters are used.

The function of the device is assigned by the assignment of the physical address.

Note

If a second output of the Power Supply SV/S is used for connection, a DV/S choke must be connected.
For further information refer to the Power supply product manual

Line coupler S

General

1.2.2

Repeater

As a repeater, the Line coupler S connects the data flow of two line segments but isolates them electrically.

Behind a line coupler (in one line), up to three repeaters can be connected in parallel in a line. This is how up to four line segments form an entire line. A line can thus be expanded from 64 possible devices (1 line) up to 256 devices (4 line segments). Every line segment must be provided with power by its own KNX power supply.

The repeaters do not have filter tables. For this reason, a telegram is sent in all line segments independently of whether or not it is processed in the respective line segment. Whether this telegram is initiated within the line or whether it has been sent from the main line via the repeater is also irrelevant.


If there is a transmission error of a physically addressed telegram, this telegram is not repeated.

If the repeater routes a telegram and does not receive an acknowledgement or there is a transmission error, the repeater repeats the telegram up to three times. With the parameters *In case of errors repeat group telegrams*, the response for both line segments is set separately.

Line coupler S General

Topology

Up to three repeaters are connected in parallel in a line. Each line segment requires its own power supply.

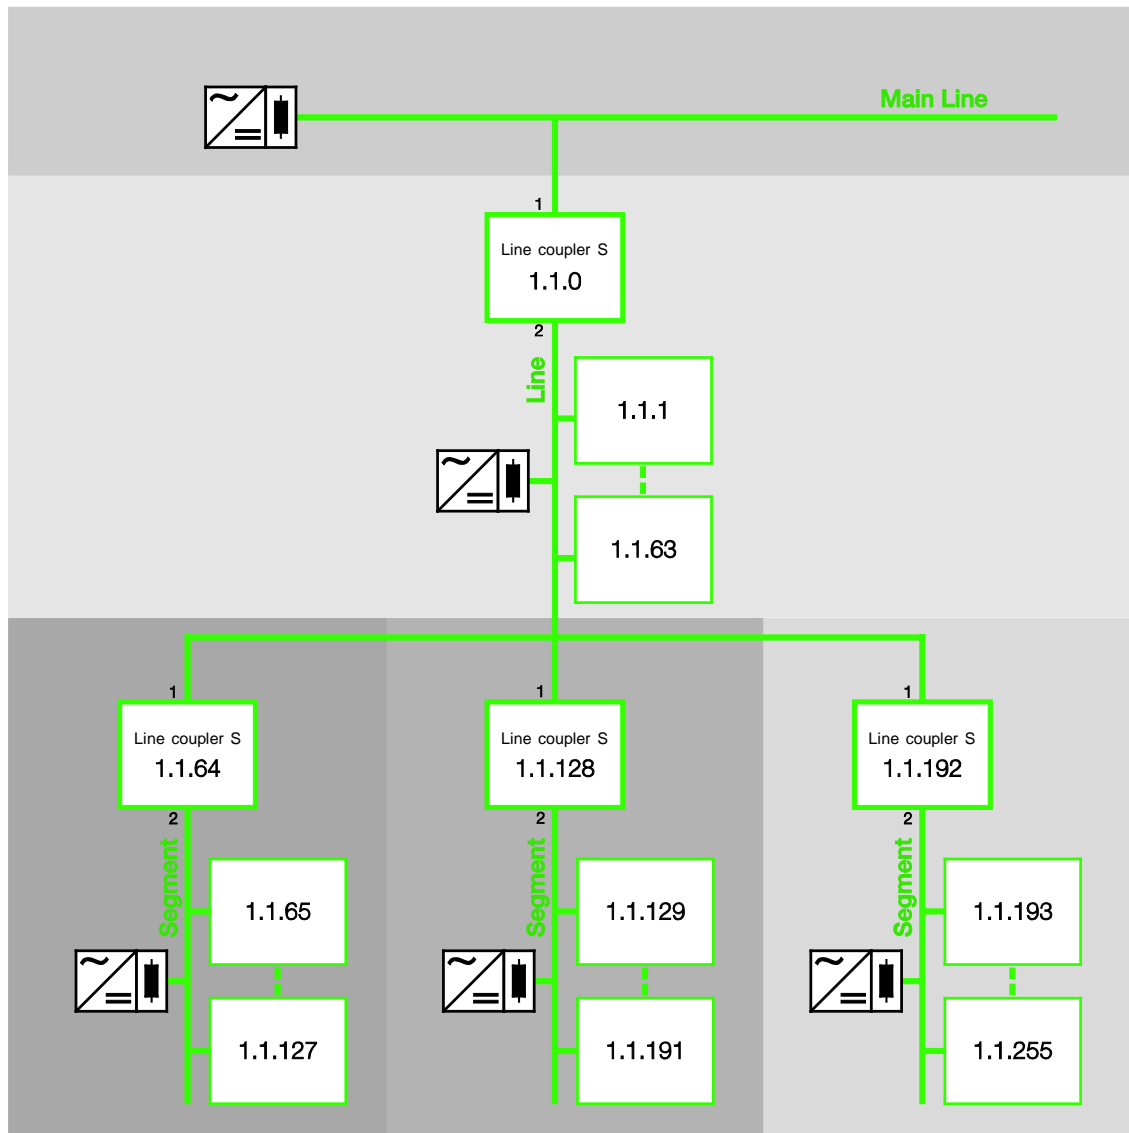

Main Line = Main line with up to 15 line couplers

Line = Line with up to three repeaters

Line Segment = Line segment, per segment up to 64 devices are possible (in total up to 256 devices are possible) including the repeater.

Note

The topology is not defined with the repeater. Under the coupler 1.1.0, the addresses 1.1.0 to 1.1.255 can be assigned as required to the segments.

Line coupler S

Device technology

2 Device technology



9070880

The Theben Line Coupler S KNX is a modular installation device with a module width of 2 space units.

It is used as a line or area coupler or as a repeater.

As a line coupler, the Line coupler S connects a line with a main line, as an area coupler it connects a main line with an area line. It provides electrical isolation in this way.

If required, the Line coupler S filters telegrams and only routes the telegrams intended for other lines. It is possible to route or block all telegrams for diagnostic purposes.

2.1 Technical data

Supply	Rated voltage	21...31 V DC, via the bus
	Power consumption	Maximum 0.25 W
	Current consumption	Maximum 12 mA
Connections	KNX, subline (2 = Line)	Via left bus connection terminal
	KNX, subline (1 = Main line)	Via right bus connection terminal
Operating and display elements	Button/LED (red)	For assignment of the physical address
	LED ON (green)	For indicating operation
	LED Main Line (yellow)	For indicating telegram traffic on the main line
	LED Line (yellow)	For indicating telegram traffic on the sub line
Enclosure	IP 20	To EN 60 529
Safety class	III, in the installed state	To EN 61 140
Insulation category	Overvoltage category	III to EN 60 664-1
	Pollution degree	II to EN 60 664-1
KNX safety extra low voltage	SELV 31 V DC	
EMC requirements	Compliant to EN 61000-6-2, EN 61000-6-3 and EN 50090-2-2	

Line coupler S

Device technology

Temperature range	Operation	-5 °C...+45 °C
	Storage	-25 °C...+55 °C
	Transport	-25 °C...+70 °C
Ambient conditions	Maximum air humidity	To EN 50 491 95 %, no condensation allowed
Design	Modular installation device (MDRC)	Modular installation device, Pro <i>M</i>
	Dimensions	90 x 36 x 64.5 mm (H x W x D)
	Mounting width	2 modules at 18 mm
	Mounting depth	64.5 mm
Installation	On 35 mm mounting rail	To EN 60 715
Mounting position	As required	
Weight without packaging	0.075 kg	
Housing/colour	Plastic housing, grey	
Approval	EN 60 669-1, EN 50 428	
KNX certification	EN 50 090-2-2, EN 50 491	
CE mark	In accordance with the EMC guideline and low voltage guideline, RoHS	

Line coupler S

Device technology

Device type	Application program	Maximum number of communication objects	Maximum number of group addresses	Maximum number of associations
Line coupler S	Couple Repeat/...*	0	0	0
	Couple/...*	0	0	0
	Repeat/...*	0	0	0

* ... = current version number of the application program.

Note

The ETS and the current version of the device application program are required for programming. The current application program can be found with the respective software information for download on the Internet at www.theben.de/downloads. After import it is available in the ETS under *Theben AG/System components/...*

The device does not support the locking function of a KNX device in the ETS. If you inhibit access to all devices of the project with a *BCU code*, it has no effect on this device. Data can still be read and programmed.

Note

Different application programs are available with the Line coupler S for ETS 3 and ETS 4. Some of the functions for the ETS 4 are not available in the applications for the ETS 3, see [Overview](#), page 17.

In ETS 3, there is a separate application for coupling and for repeating (*Couple/1.x* or *Repeat/1.x*), in ETS 4, there is a common application (*Couple Repeat/2.x*).


All applications are upwards compatible, i.e.:

- The old applications of Line coupler can be loaded in the Line coupler S (ETS 3). This is particularly useful if in an existing project an Line coupler has to be replaced by an Line coupler S.
- The applications *Couple/1.x* or *Repeat/1.x* can be loaded in the Line coupler S via the ETS 3 or the ETS 4.
- The new application *Couple Repeat/2.x* with extended functional range is only available for the ETS 4.

Line coupler S



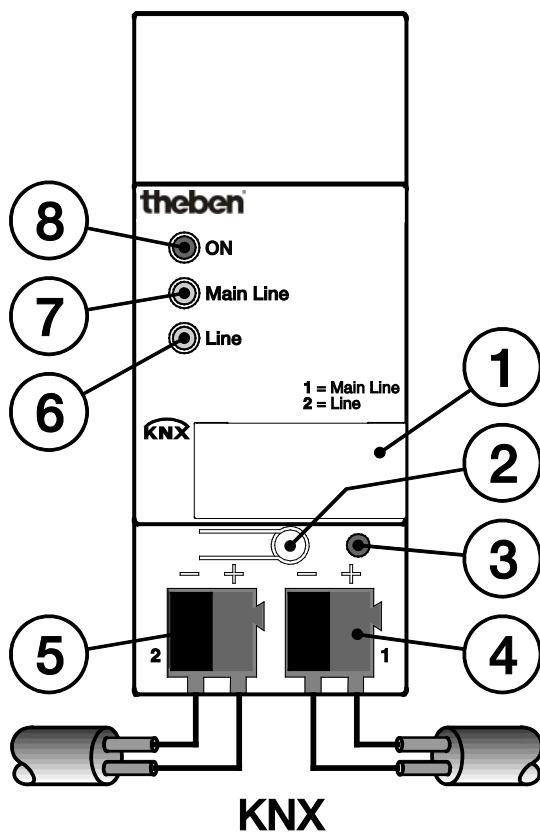


Device technology

2.2 Circuit diagram



9070880


Line coupler S

- 1 Label carrier
- 2 Button *Programming* 
- 3 LED *Programming*  (red)
- 4 Bus connection terminal of the primary/main line
- 5 Bus connection terminal of the secondary line
- 6 LED  **Line** (yellow)
- 7 LED  **Main Line** (yellow)
- 8 LED  **ON** (green)

Note

The main and secondary lines must each be supplied with power from separate power sources (electrically isolated).

2.3 Dimension drawing

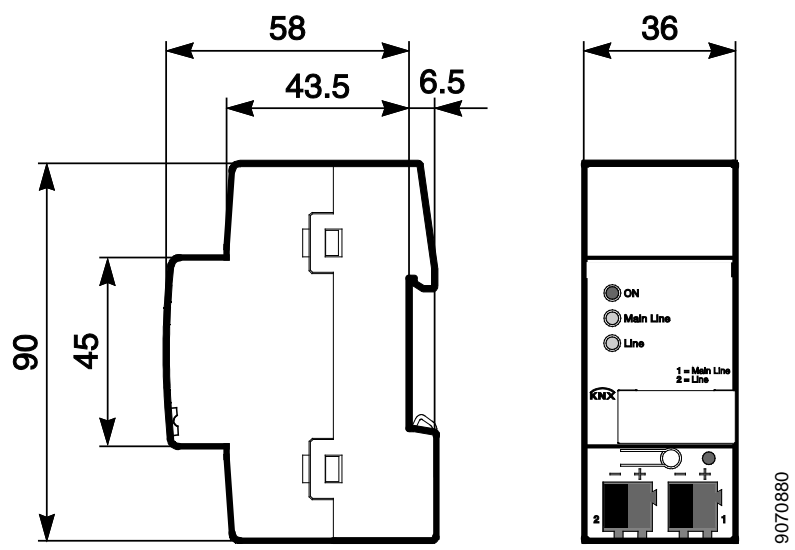

Line coupler S

9070880

2.4 Assembly and installation

The Line coupler S is a modular installation device for quick installation in the distribution board on 35 mm mounting rails to EN 60 715.

The Line coupler S mounting position can be selected as required.

The connection to the bus is established using the supplied bus connection terminals.

Accessibility to the Line coupler S for the purpose of operation, testing, visual inspection, maintenance and repair must be provided compliant to VDE 0100-520.

Commissioning requirements

In order to commission the Line coupler S, a PC with ETS and a KNX interface, e.g. USB or IP, are required. The Line coupler S is ready for operation, after bus voltage is connected to the main line.

For programming the Line Coupler, it is necessary to at least connect the primary line. If the secondary subline is also connected, the Line coupler S can also be programmed from the secondary subline.

The installation and commissioning may only be carried out by electrical specialists. The appropriate norms, guidelines, regulations and specifications for your country should be observed when planning and setting up electrical installations and security systems for intrusion and fire detection.

Protect the device from damp, dirt and damage during transport, storage and operation.

Only operate the device within the specified technical data limits!




The device should only be operated in an enclosed housing (distribution board)!

Supplied state

The Line coupler S is supplied with the physical address 15.15.0.

Assignment of the physical address

The assignment and programming of the physical address is carried out in the ETS.

Button  on the Line coupler S is pressed to assign the physical address. The red LED  lights up. It switches off, as soon as the ETS has assigned the physical address or button  has been pressed again. The selection of the physical address is dependent on the required device function (coupler or repeater).

For further information see: [Product and functional overview](#), page 5.

Cleaning

If devices become dirty, they can be cleaned using a dry cloth or a cloth dampened with a soapy solution. Corrosive agents or solutions should never be used.

Maintenance

The Line coupler S is maintenance-free. No repairs should be carried out by unauthorised personnel if damage occurs, e.g. during transport and/or storage.




Line coupler S

Device technology

2.4.1 Display elements

Indicator LEDs are located on the front of the Line coupler S.

The response of the display elements is described in the following table:

LED	KNX operation
 ON	<i>OFF</i> : The Line coupler S is not operational. No power supply is applied or it has malfunctioned. <i>ON</i> : The Line coupler S is operational and is supplied by the main line. The power supply is applied.
 Main Line	<i>OFF</i> : No main line connected or voltage failure on the main line. <i>ON</i> : The main line is connected. <i>Flashes</i> : Telegram traffic on the main line.
 Line	<i>OFF</i> : No line connected or voltage failure on the line. <i>ON</i> : A line is connected. <i>Flashes</i> : Telegram traffic on the line.

Line coupler S

Commissioning

3 Commissioning

The parameterization of the Line coupler S is undertaken using application program *Couple Repeat/2*, *Couple/1* or *Repeat/1* and the Engineering Tool Software ETS.

The application program can be found at *Theben AG/System components/...*

For parameterization purposes, a PC or Laptop with ETS and a connection to the KNX, e.g. via RS232, USB or IP interface, is required.

3.1 Overview

The following table provides an overview of the functions possible with the Line coupler S and the application programs *Couple Repeat 2.x* (ETS 4) as well as *Couple/1.x* or *Repeat/1.x* (ETS 3).

Line/Area Coupler properties	ETS 3	ETS 4
Function <i>Line/Area Coupler</i>	■	■
Filter group telegrams main group 0...13	■	■
Filter group telegrams main group 14...31		■
Block physically addressed telegrams		■
Block broadcast telegrams		■
In case of errors repeat telegrams	■	■
Telegram confirmation	■	■

■ = property applies

Repeater properties	ETS 3	ETS 4
Function <i>Repeater</i>	■	■
In case of errors repeat telegrams	■	■

■ = property applies

Line coupler S

Commissioning

3.2 Parameters

The parameterization of the Line coupler S is implemented using the Engineering Tool Software ETS.

The application program can be found in the ETS at *Theben AG/System components/...*

The following chapter describes the parameters of the Line coupler S using the parameter windows. The parameter windows feature a dynamic structure, so that further parameters may be enabled depending on the parameterization and the function.

The default values of the parameters are underlined,

e.g.:

Options: yes
 no

3.2.1 Application for ETS 4


The application *Couple Repeat/2.x* with extended functional range is only available for the Line coupler S and ETS 4.1.2 or higher.

Line coupler S

Commissioning

3.2.1.1 Parameter window *General*

The device functions are defined in this parameter window.



Device function

Options: Line/Area Coupler
 Repeater

- *Line/Area Coupler*: The data flow between two lines is connected. Both lines are electrically isolated from one another. The Parameter window [Main line --> Line](#), page 20, and Parameter window [Line --> Main line](#), page 23, appear.
- *Repeater*: The data flow between two line segments is connected. Both lines are electrically isolated from one another. Parameter window [Settings](#), page 24, is enabled.

Line coupler S

Commissioning

3.2.1.2 Device function - *Line/Area Coupler*

3.2.1.2.1 Parameter window *Main line --> Line*

This parameter window is visible if in Parameter window [General](#), page 19, the device function *Line/Area Coupler* has been selected.

In this parameter window, the settings for the connection from the primary/main line to the line are undertaken.

General	Group telegrams main group 0...13	filter
Main line --> Line	Group telegrams main group 14...31	filter
Line --> Main line	Physically addressed telegrams	filter
	Broadcast telegrams	route
	In case of errors repeat telegrams	yes
	Telegram confirmation	only if routed
	If free group address structure is used:	<-- Note
	Main group 0...13 => 1...28,671	
	Main group 14...31 => 28,672...65,535	

Group telegrams main group 0...13

Group telegrams main group 14...31

Option: filter
route
block

- *filter*: Only group telegrams entered into the filter table are routed. The ETS automatically creates the filter table.
- *route*: All group telegrams are routed.
- *Block*: All group telegrams are blocked.

Physically addressed telegrams

Option: filter
block

- *filter*: Physically addressed telegrams (programming telegrams) are routed according to the topology.
- *block*: Physically addressed telegrams are blocked.

Line coupler S

Commissioning

Broadcast telegrams

Options: route
block

Broadcast telegrams are used, for example, by the ETS to identify KNX devices in programming mode.

- *route*: Broadcast telegrams are routed.
- *Block*: Broadcast telegrams are blocked.

In case of errors repeat telegrams

Options: yes
no
user-defined

- *yes*: If an error is detected when a telegram is transmitted, the telegram is repeated up to three times.
- *no*: The telegram is not repeated.
- *user-defined*: The response can be set individually for different types of telegram.

Repeat group addressed telegrams

Options: yes
no

- *yes*: If an error is detected when a group addressed telegram is transmitted, the telegram is repeated up to three times.
- *no*: The telegram is not repeated.

Repeat physically addressed telegrams

Options: yes
no

- *yes*: If an error is detected when a physically addressed telegram is transmitted, the telegram is repeated up to three times.
- *no*: The telegram is not repeated.

Repeat broadcast telegrams

Options: yes
no

- *yes*: If an error is detected when a broadcast telegram is transmitted, the telegram is repeated up to three times.
- *no*: The telegram is not repeated.

Line coupler S

Commissioning

Telegram confirmation

Options: only if routed
 always

- *only if routed*: Telegrams that are routed are acknowledged.
- *always*: Every telegram is acknowledged.

The following applies with a group address view:

Main groups 0...13 => 1...28,671

Main groups 14...31 => 28,672...65,535

<---NOTE

In the ETS 4 it is possible to not just assign two or three-stage group addresses, it is possible to freely assign them. If the free group address view is selected, main group 0...13 corresponds to subgroup range 1...28,671 and main group 14...31 with subgroup range 28,672...65,535. Relevant details can be read with the assistance of the Help in the ETS.

Line coupler S

Commissioning

3.2.1.2.2 **Parameter window *Line --> Main line***

This parameter window is visible if in Parameter window [General](#), page 19, the device function *Line/Area Coupler* has been selected.

In this parameter window, the telegram functions for the connection from a secondary line to the primary/main line are defined.


The parameter setting of the connections *Line --> Main line* and *Main line --> Line* do not differentiate from one another. The descriptions of the parameter setting options are described in Parameter window [Main line --> Line](#), page 20.

Line coupler S

Commissioning

3.2.1.3 Device function *Repeater*

3.2.1.3.1 Parameter window *Settings*

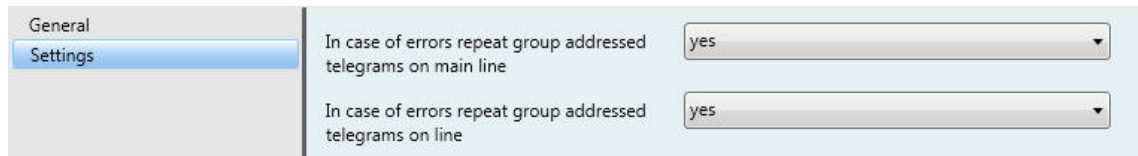

This parameter window is visible if in Parameter window [General](#), page 19, the device function *Repeater* has been selected.

In case of errors repeat group addressed telegrams on main line

Options: yes
 no

- *yes*: If an error is detected when a group addressed telegram is transmitted on the main line, the telegram is repeated up to three times.
- *no*: The telegram is not repeated.

In case of errors repeat group addressed telegrams on line

Options: yes
 no

- *yes*: If an error is detected when a group addressed telegram is transmitted on a line, the telegram is repeated up to three times.
- *no*: The telegram is not repeated.


Line coupler S Commissioning

3.2.2 Applications for the ETS 3

The applications *Couple/1.x* and *Repeat/1.x* can be loaded in the Line coupler S via the ETS 3.

3.2.2.1 Application *Couple/1.x*, parameter window *Settings*

In this parameter window, the settings for the Area/Line Coupler are defined.

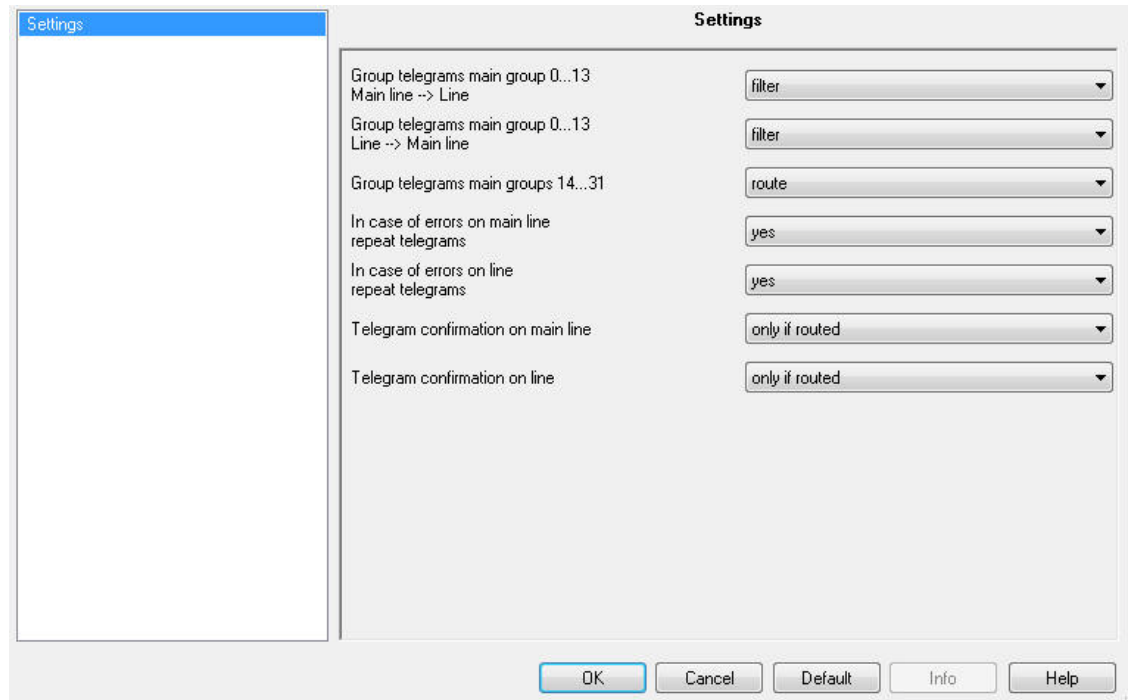

Group telegrams main group 0...13 Main line --> Line

Group telegrams main group 0...13 Line --> Main line

Option: filter
route
block

- *filter*: Only group telegrams entered into the filter table are routed. The ETS automatically creates the filter table.
- *route*: All group telegrams are routed.
- *Block*: All group telegrams are blocked.

Line coupler S

Commissioning

Group telegrams main group 14...31

Options: route
 block

- *route*: All group telegrams are routed.
- *Block*: All group telegrams are blocked.

In case of errors repeat group addressed telegrams on main line

In case of errors repeat group addressed telegrams on line

Options: yes
 no

- *yes*: If an error is detected when a telegram is transmitted, the telegram is repeated up to three times.
- *no*: The telegram is not repeated.

Telegram confirmation on Main Line

Telegram confirmation on Line

Options: only if routed
 always


- *only if routed*: Telegrams that are routed are acknowledged.
- *always*: All telegrams are acknowledged.

Line coupler S Commissioning

3.2.2.2 Application *Repeat/1x*

3.2.2.2.1 Parameter window *Settings*

In this parameter window, the settings for the function *Repeater* are undertaken.

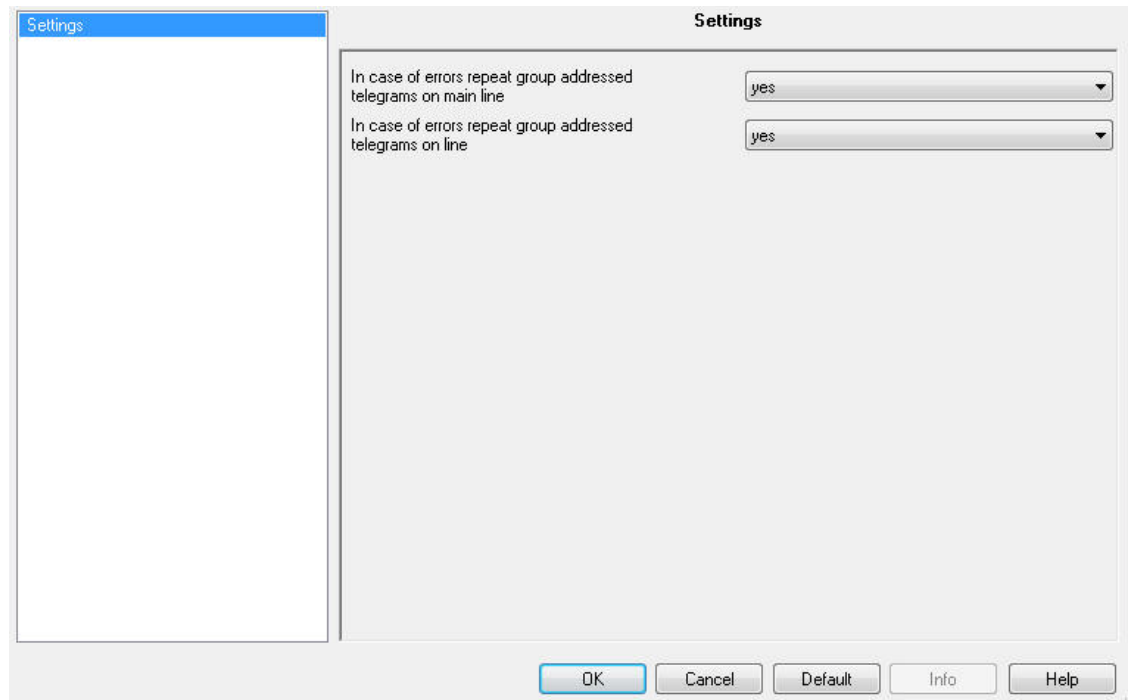

In case of errors repeat group addressed telegrams on main line

Options: yes
 no

- *yes*: If an error is detected when a group addressed telegram is transmitted on the main line, the telegram is repeated up to three times.
- *no*: The telegram is not repeated.

In case of errors repeat group addressed telegrams on line

Options: yes
 no

- *yes*: If an error is detected when a group addressed telegram is transmitted on a line, the telegram is repeated up to three times.
- *no*: The telegram is not repeated.

A **Appendix**

A.1 **Scope of delivery**

The Theben AG Line coupler S is supplied together with the following components.

Please check the items received using the following list.

- 1 x Line coupler S
- 1 x installation and operating instructions
- 2 x bus connection terminal (red/black)

theben 309506

Montage- und Betriebsanleitung
Installation and Operating Instructions

Linienkoppler S KNX
Line Coupler S KNX

9070880

Theben AG
Hohenbergstr. 32
72401 Haigerloch
Tel. +49 7474 692-0
Fax +49 7474 692-150
Service
Tel. +49 7474 692-369
Fax +49 7474 692-207
hotline@theben.de
Addresses, telephone numbers etc. at
www.theben.de

Geräte-Anschluss


- ① Schildträger
- ② Programmier Taste
- ③ Programmier-LED
- ④ Busanschlussklemme für KNX-Anschluss der Primär-/Hauptlinie (Main Line)
- ⑤ Busanschlussklemme für KNX-Anschluss der Sekundärlinie (Line)
- ⑥ LED für Telegrammverkehr auf Sekundärlinie (Line)
- ⑦ LED für Telegrammverkehr auf Primär-/Hauptlinie (Main Line)
- ⑧ Betriebs-LED

Gerätebeschreibung
Der Linienkoppler S KNX ermöglicht den Datenaustausch zwischen zwei getrennten KNX-Buslinien und sorgt für eine galvanische Trennung der Linien. Dadurch können beide Linien unabhängig voneinander betrieben werden. Er kann als Bereichskoppler, Linienkoppler oder als Linienverstärker in einer Linie betrieben werden.

Technische Daten (Auszug)

Versorgung über KNX-Bus (21 ... 30 V DC)
im Betrieb
Temperaturbereich -5 °C ... +45 °C
Umgebungsbedingung maximale Luftfeuchte 95 %, keine Betauung zulässig
IP 20 nach EN 60529
Schutzart III nach EN 61140
Schutzklasse
Gewicht 0,075 kg

Montage
Das Gerät ist geeignet zum Einbau in Verteilern oder Kleingehäusen für Schnellbefestigung auf 35 mm Tragschienen (nach EN 60715). Die Zugänglichkeit des Gerätes zum Betreiben, Prüfen, Besichtigen, Warten und Reparieren muss sichergestellt sein.

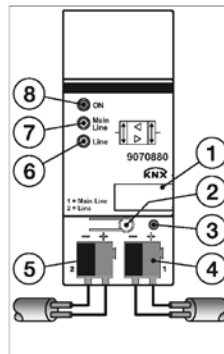

Bedienung und Anzeige

- On ⑧ leuchtet grün, wenn die Spannungsversorgung vorhanden ist und das Gerät betriebsbereit ist
- ④ Main Line ④ leuchtet gelb, sobald die Hauptlinie angeschlossen ist; blinkt bei Telegrammverkehr auf der Hauptlinie
- ⑤ Line ⑤ leuchtet gelb, sobald die Sekundärlinie angeschlossen ist; blinkt bei Telegrammverkehr auf der Sekundärlinie
- Programmier-LED ③ leuchtet rot, wenn das Gerät im Programmiermodus ist (nachdem die Programmier Taste ② gedrückt wurde)

Anschluss

Die Klemmenbezeichnungen befinden sich auf dem Gehäuse. Die Verbindung zum KNX erfolgt mit der mitgelieferten Busanschlussklemme.

Operation and display

- On ⑧ lights green when voltage is applied and the device is ready for operation.
- ④ Main Line ④ lights yellow when the main line is connected; flashes when there is telegram traffic on the main line.
- ⑤ Line ⑤ lights yellow when the line is connected; flashes when there is telegram traffic on the line.
- Programming LED ③ lights red when the device is in the programming mode. (After the programming button ② has been pressed).

Connection

The terminal identifiers can be found on the housing. The connection to KNX is made via the supplied bus terminal.

Inbetriebnahme
Die Inbetriebnahme erfolgt mit der Engineering Tool Software (ETS). Eine ausführliche Beschreibung der Parametrierung und Inbetriebnahme finden Sie in der technischen Dokumentation des Gerätes. Diese finden Sie zum Download unter www.theben.de.

⚠️ WARNUNG
Lebensgefahr durch elektrischen Schlag oder Brand!
➤ Montage ausschließlich von Elektrofachkraft durchführen lassen!

Für die fachgerechte Verlegung der Busleitungen und die Inbetriebnahme der Geräte die Vorgaben der EN 50428 für Schalter oder ähnliches Installationsmaterial zur Verwendung in der Gebäudesystemtechnik beachten! Eingriffe und Veränderungen am Gerät führen zum Erlöschen des Garantieanspruches.

Commissioning

Commissioning of the system is carried out using the Engineering Tool Software (ETS). A detailed description of the parameter configuration and commissioning steps can be found in the technical documentation of the unit. This information can be downloaded at www.theben.de.

⚠️ WARNUNG
Danger of death through electric shock or fire!
➤ Installation should only be carried out by professional electrician!

The professional installation of bus lines and commissioning of devices requires compliance with the provisions of EN 50428 for switches or similar installation equipment for use in building construction technology. Tampering with, or making modifications to, the device invalidates the guarantee.

Device connection

- ① Label carrier
- ② Programming button
- ③ Programming LED
- ④ Bus terminal for the KNX connection of the primary/main line
- ⑤ Bus terminal for the KNX connection of the secondary line
- ⑥ LED for telegram traffic on the secondary line
- ⑦ LED for telegram traffic on the primary/main line
- ⑧ Power LED

Device description
The line coupler S KNX enables the exchange of data between two separate KNX bus lines, both lines can be used independently from each other. The line coupler S KNX can be used as an area coupler, line coupler or line amplifier.

Technical data (excerpt)

Power supply via bus KNX (21 ... 30 V DC)
Operating
Temperature range -5 °C ... +45 °C
Ambient conditions 95 %, condensation-free
Maximum humidity
IP rating IP 20 according to EN 60 529
Protection class III according to EN 61140
Weight 0.075 kg

Installation
The unit is designed to be installed in distribution boxes or small housings for quick mounting on 35 mm support rails in accordance with EN 60715. Ensure that the unit can be accessed at all times for operation, examination, inspection, maintenance, and repair.

